
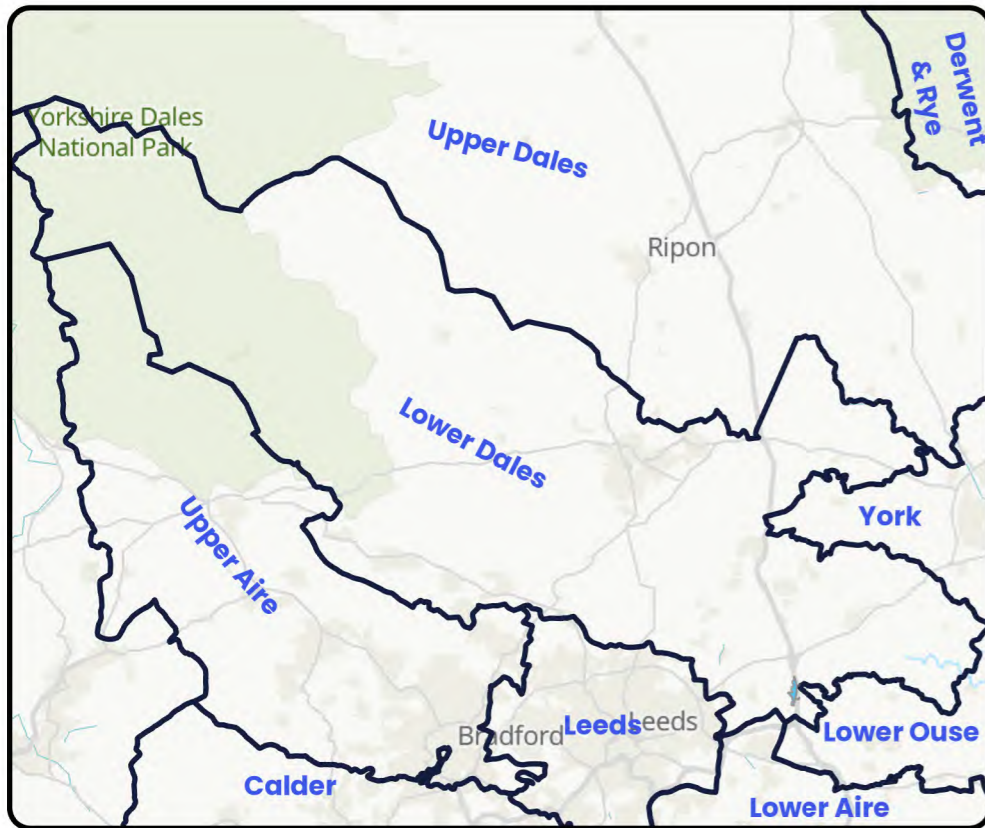


Aberford Lower Dales

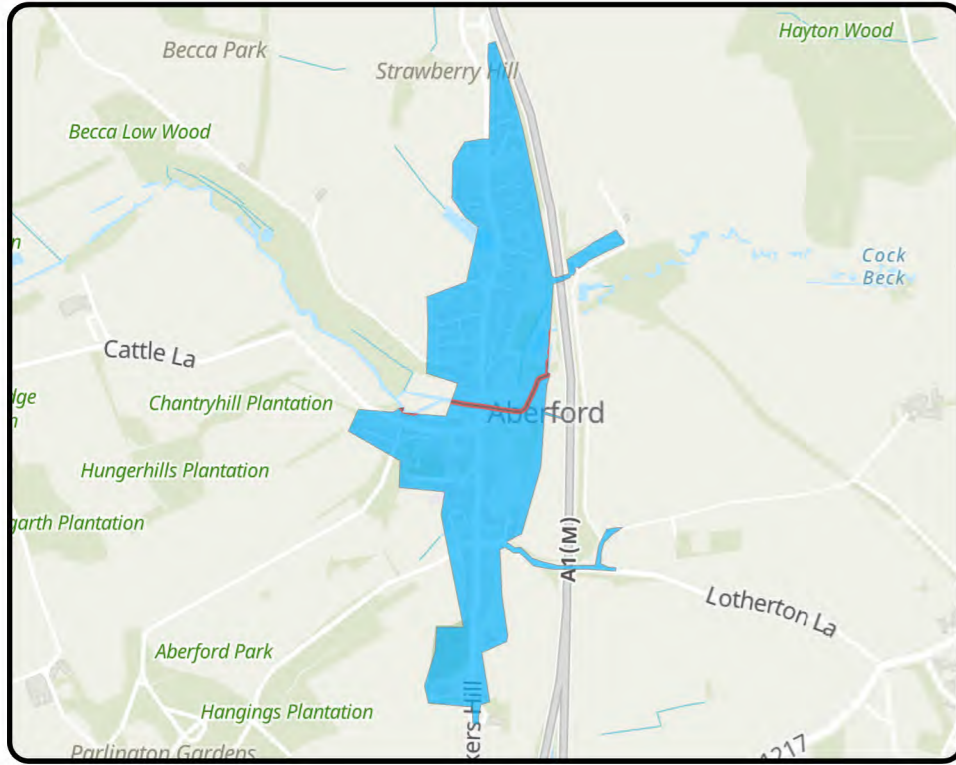

Outcome: Investigate

Work to understand in more detail the size and scale of the predicted catchment risk

Key Catchment Statistics	
2020 Population Equivalent	1,433
2050 Population Equivalent	1,819
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	9.6km
Surface Water Sewer Length	4.2km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low


Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a moderate risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	Yes	No	No	No	No	No	No	Yes	Yes	Yes	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	0	0	2	2	2	2	1	2	1.5	2	2.5	5	5	5	1	1	2



AppleTreeWick Lower Dales

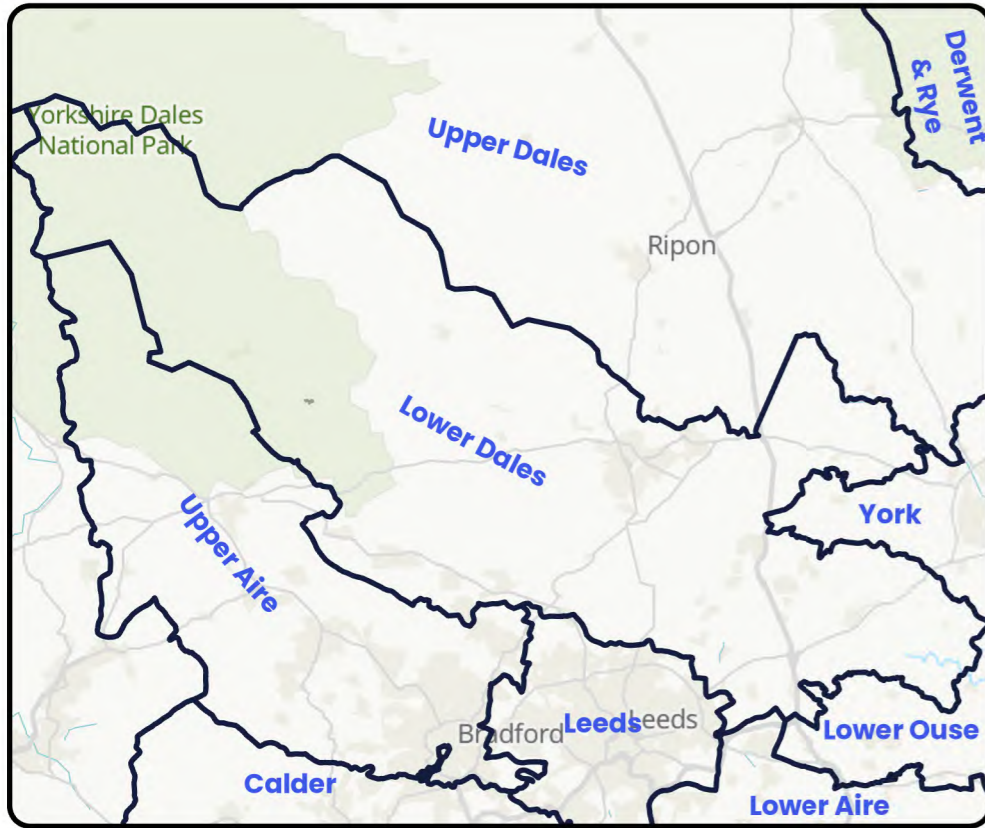

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	106
2050 Population Equivalent	109
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0.6km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low



Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

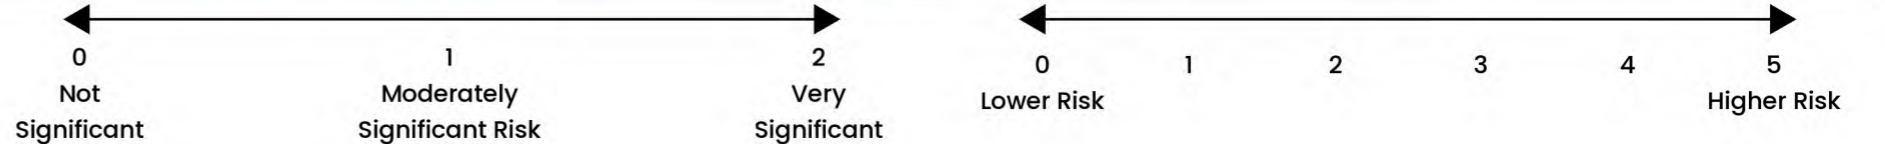

Barwick in Elmet Lower Dales

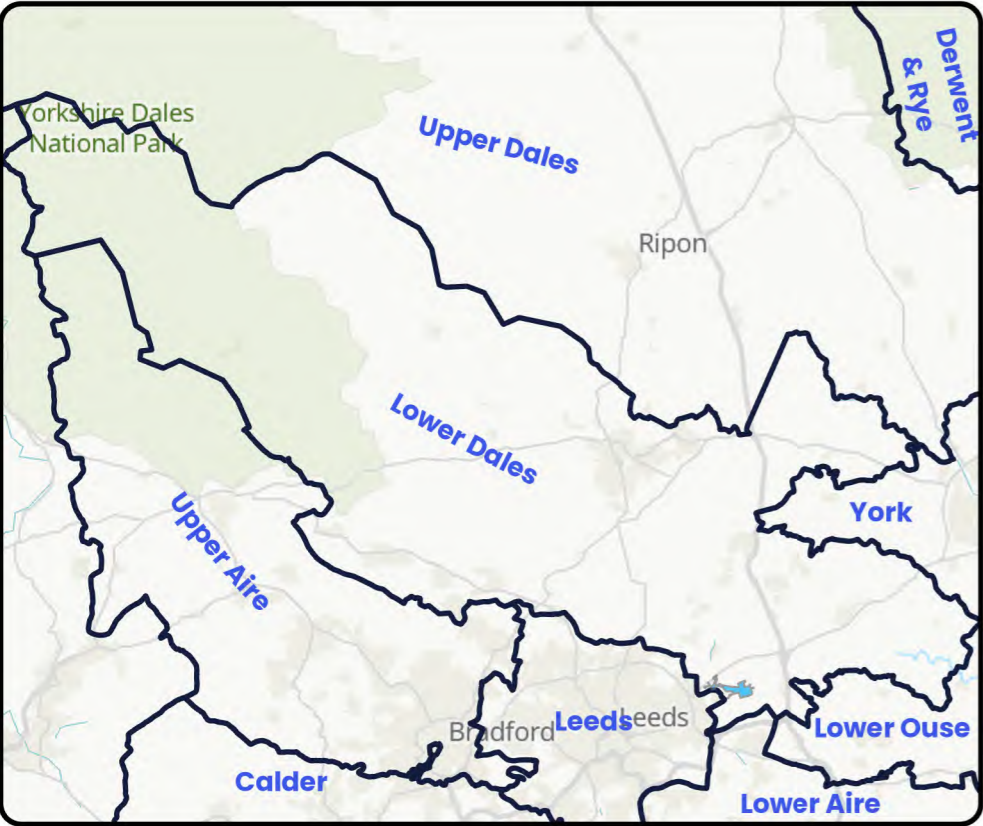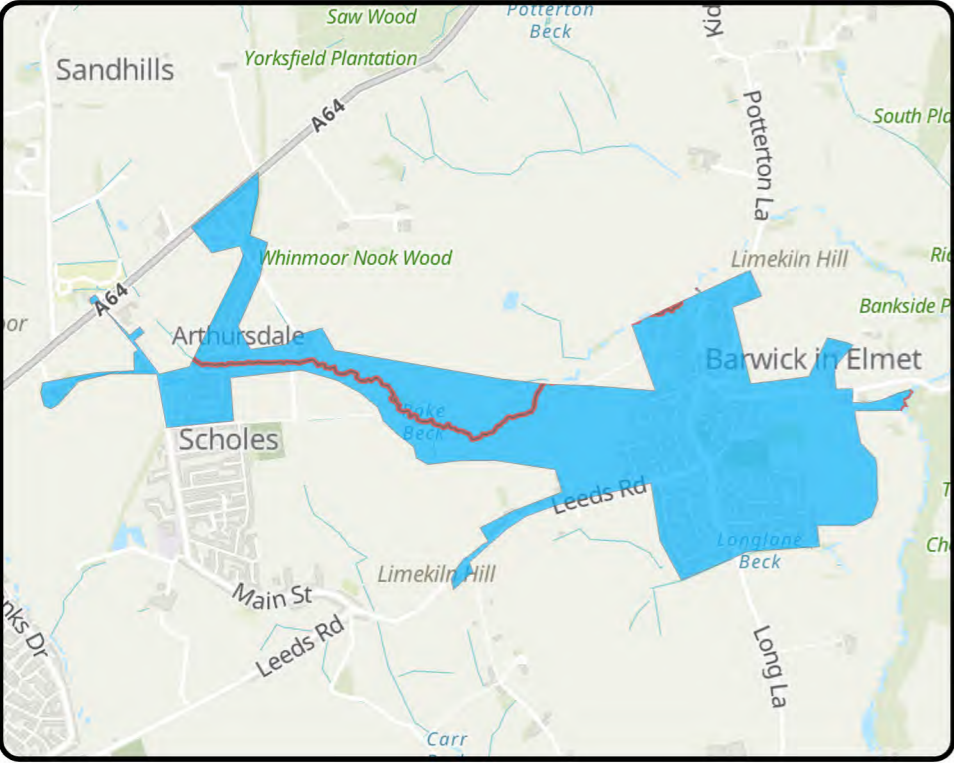

Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working

Key Catchment Statistics	
2020 Population Equivalent	3,357
2050 Population Equivalent	4,341
Modelled Consented Storm Overflows	4
Wastewater Pumping Stations	4
Foul and Combined Sewer Length	17.9km
Surface Water Sewer Length	7.9km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Medium

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a moderate risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	Yes	Yes	Yes	No	No	No	No	Yes	No	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	2	0	1	1	0	1	0	0	3	4	4.5	2	2	3	1	1	1



Beamsley Lower Dales


Outcome: Monitor

Continue to monitor all potential risks in the catchment and promote once a suitable threshold is breached



Key Catchment Statistics	
2020 Population Equivalent	153
2050 Population Equivalent	165
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	2
Foul and Combined Sewer Length	1.6km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	Yes
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a moderate risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

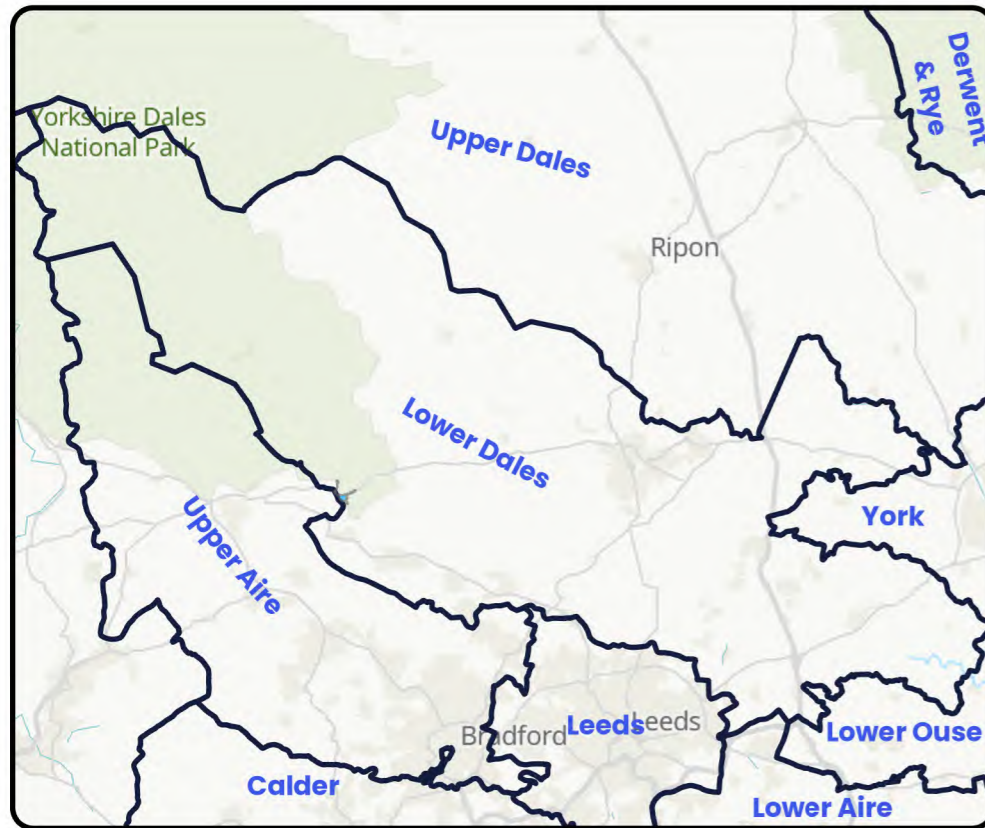

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	Yes	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
0	0	0	2	2	1	1	N/A	N/A	2	2.5	2.5	5	5	5	1	1	1

0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk



Beckwithshaw Lower Dales


Outcome: Observe

Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles



Key Catchment Statistics	
2020 Population Equivalent	228
2050 Population Equivalent	244
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0.7km
Surface Water Sewer Length	0.2km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

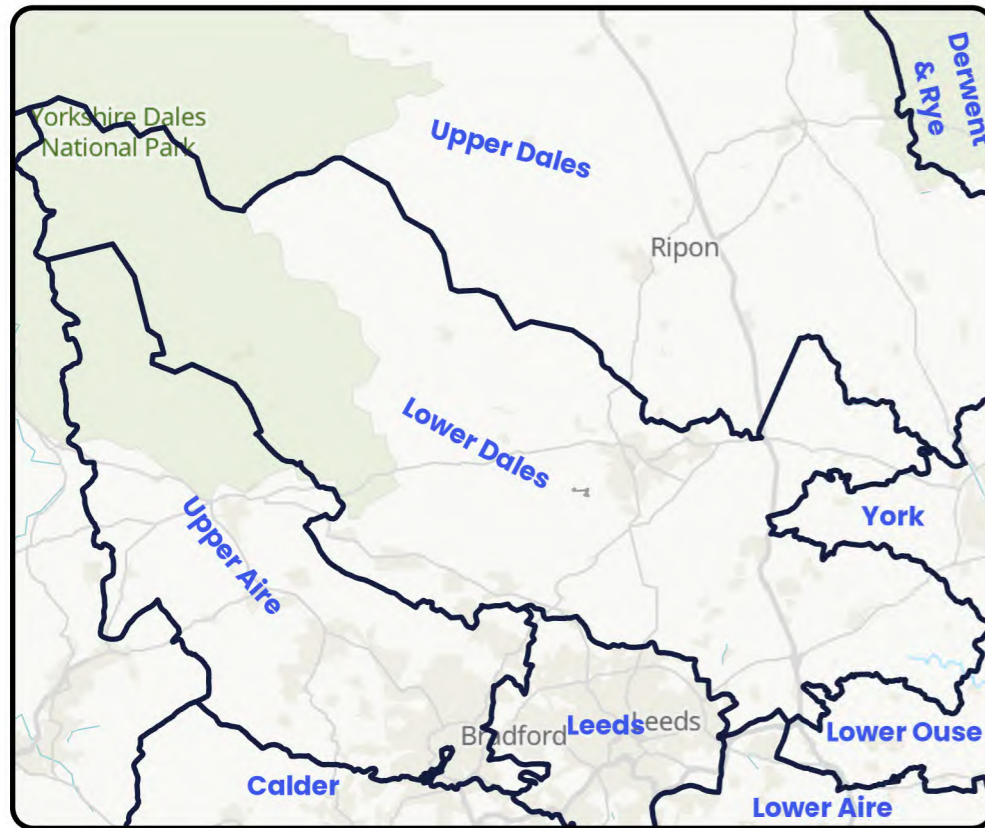

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	Yes	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A


0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk



Ben Rhydding Lower Dales


Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working

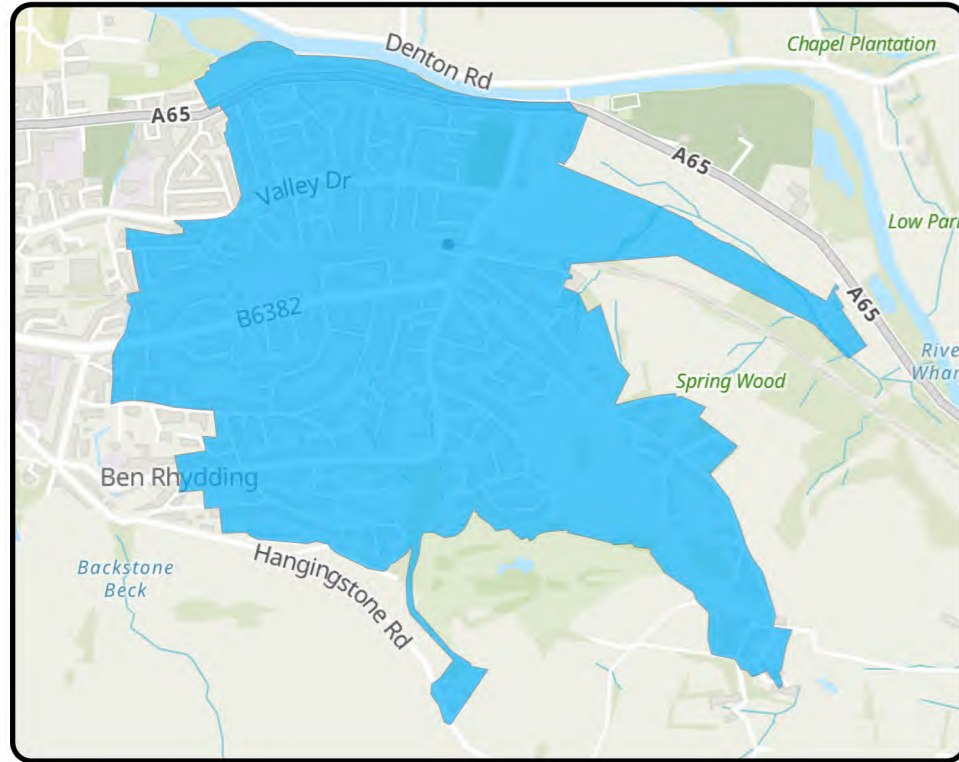


Key Catchment Statistics	
2020 Population Equivalent	4,536
2050 Population Equivalent	5,579
Modelled Consented Storm Overflows	5
Wastewater Pumping Stations	1
Foul and Combined Sewer Length	24.1km
Surface Water Sewer Length	2.9km
Site of Special Scientific Interest Present	Yes
Special Area of Conservation Present	Yes
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050


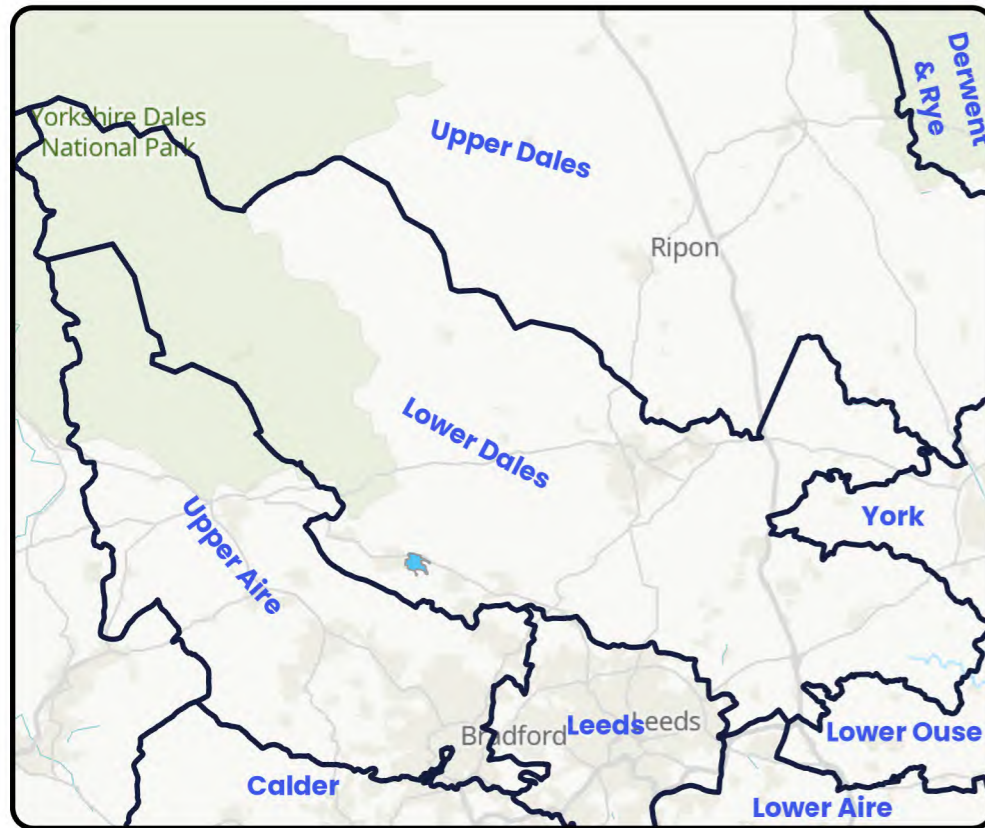


Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	Yes	No	Yes	Yes	No	No	No	No	No	Yes	No	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
1	2	0	1	2	2	2	0	0	3	3.5	4	4	4	4	1	1	1

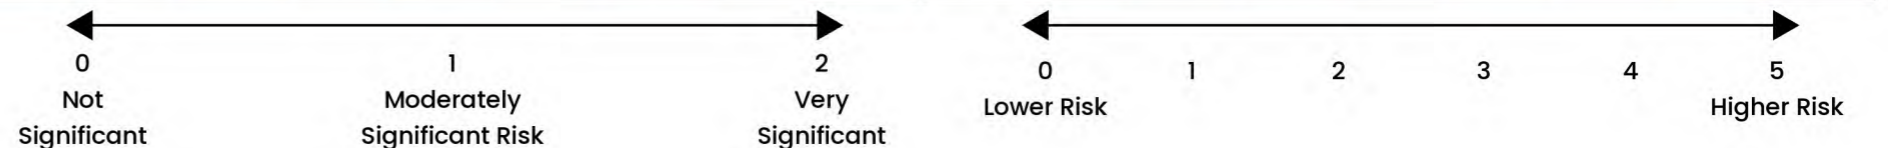

Bland Hill Lower Dales

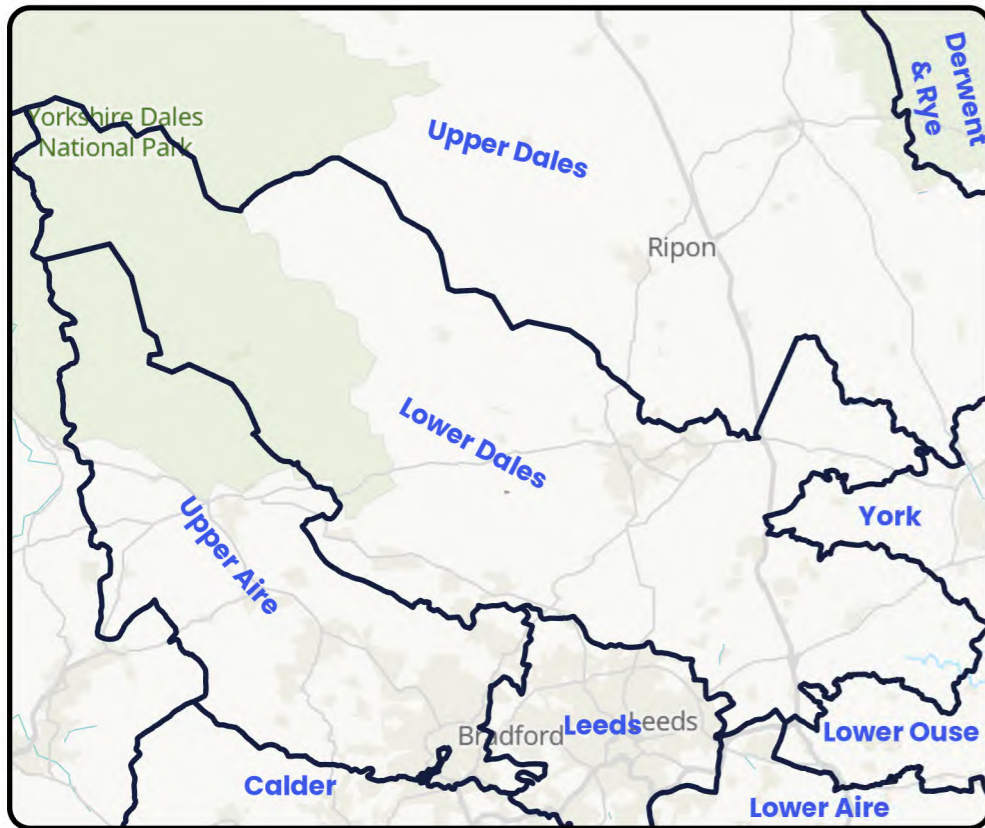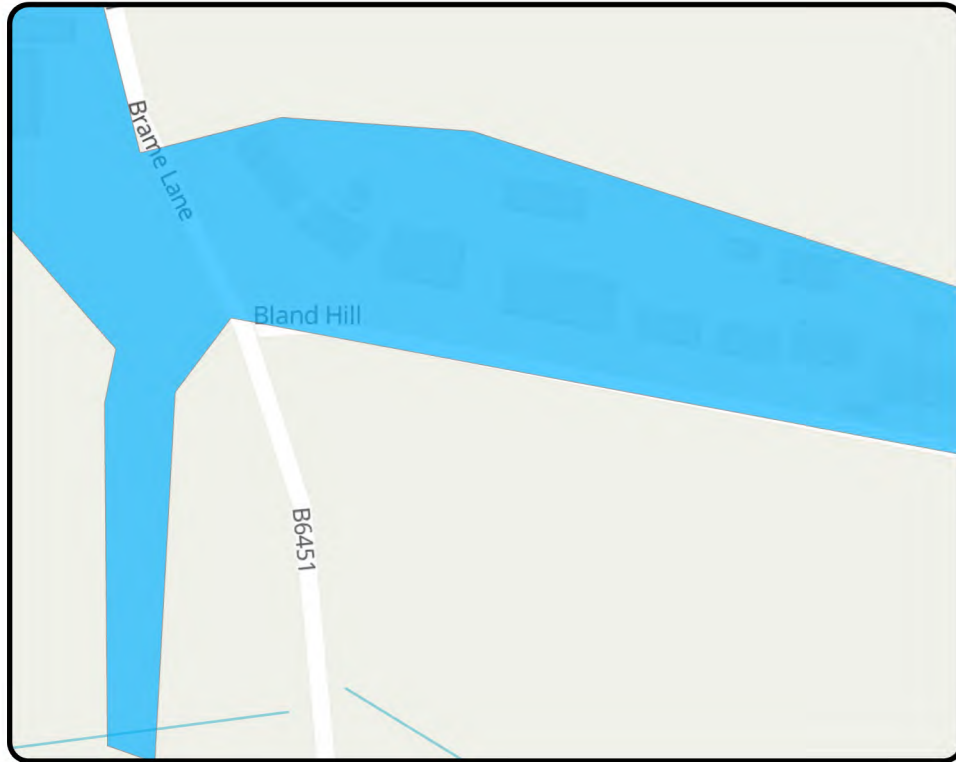

Outcome: Observe

Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	39
2050 Population Equivalent	40
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0.2km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low



Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk

Blubberhouses Lower Dales

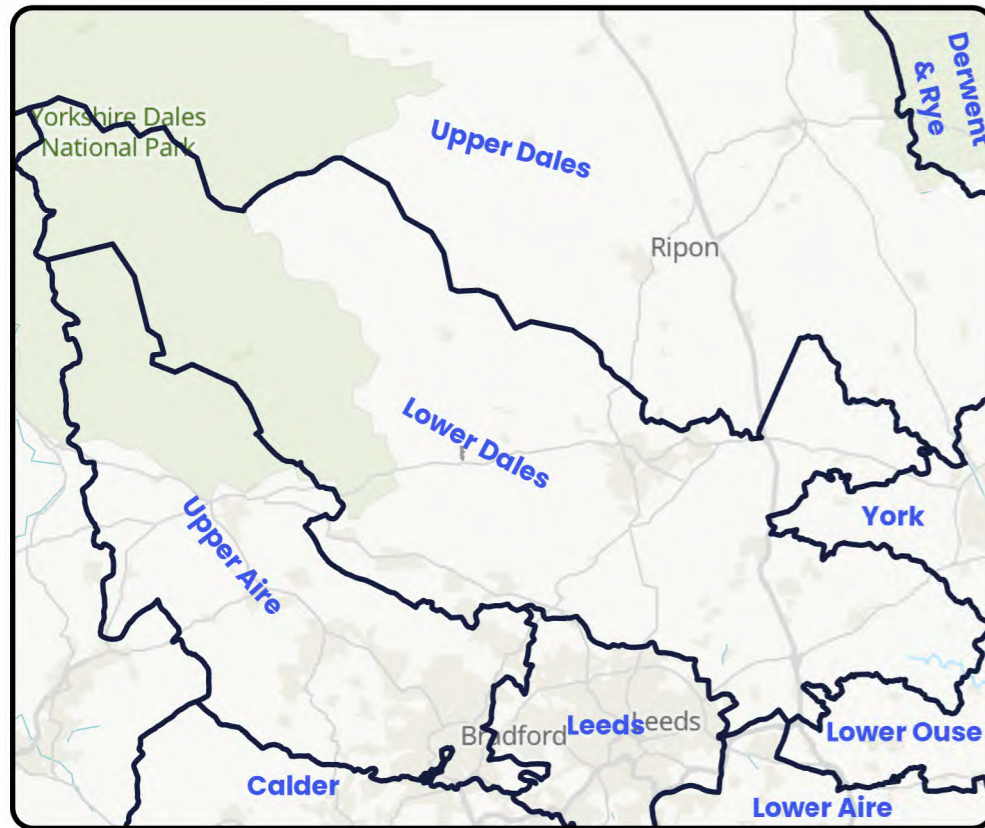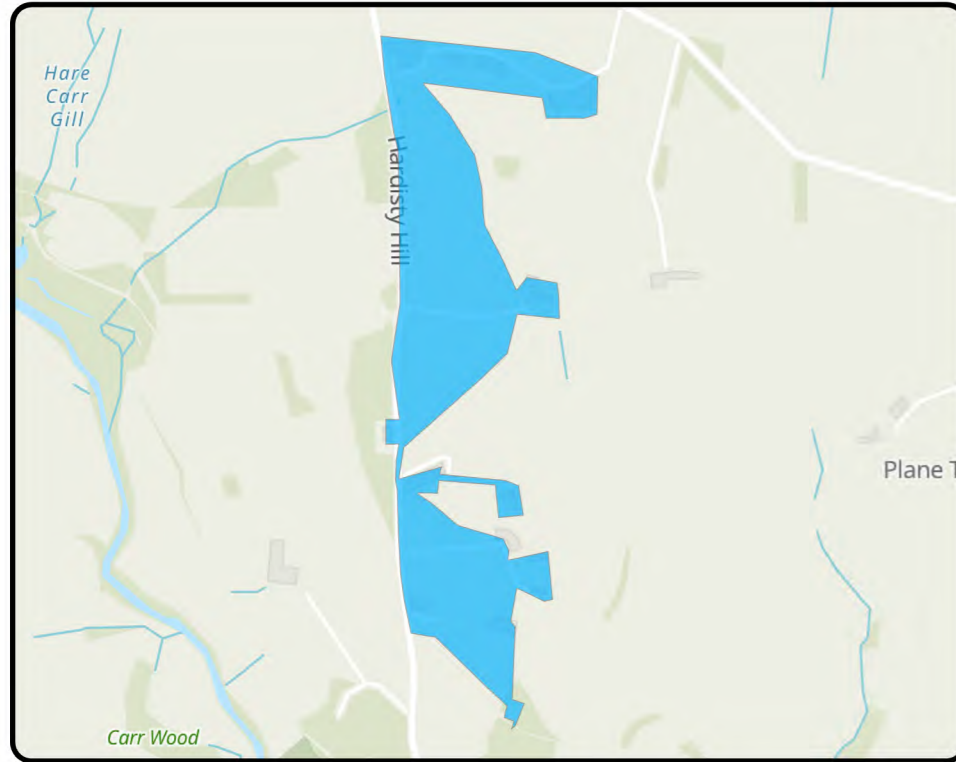

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	72
2050 Population Equivalent	76
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	1
Foul and Combined Sewer Length	0.3km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low



Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

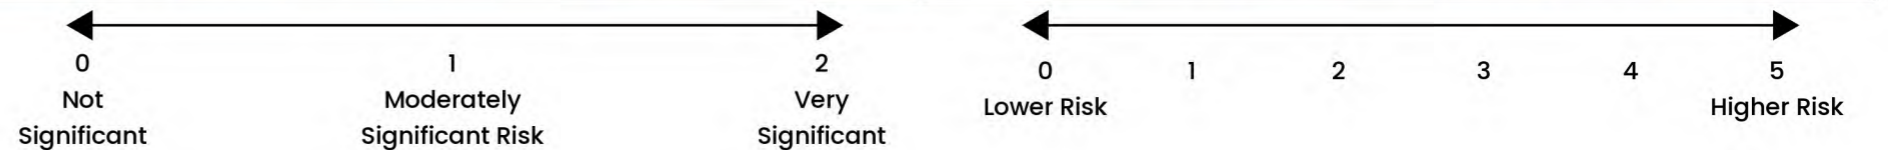

Blubberhouses Hall Lower Dales

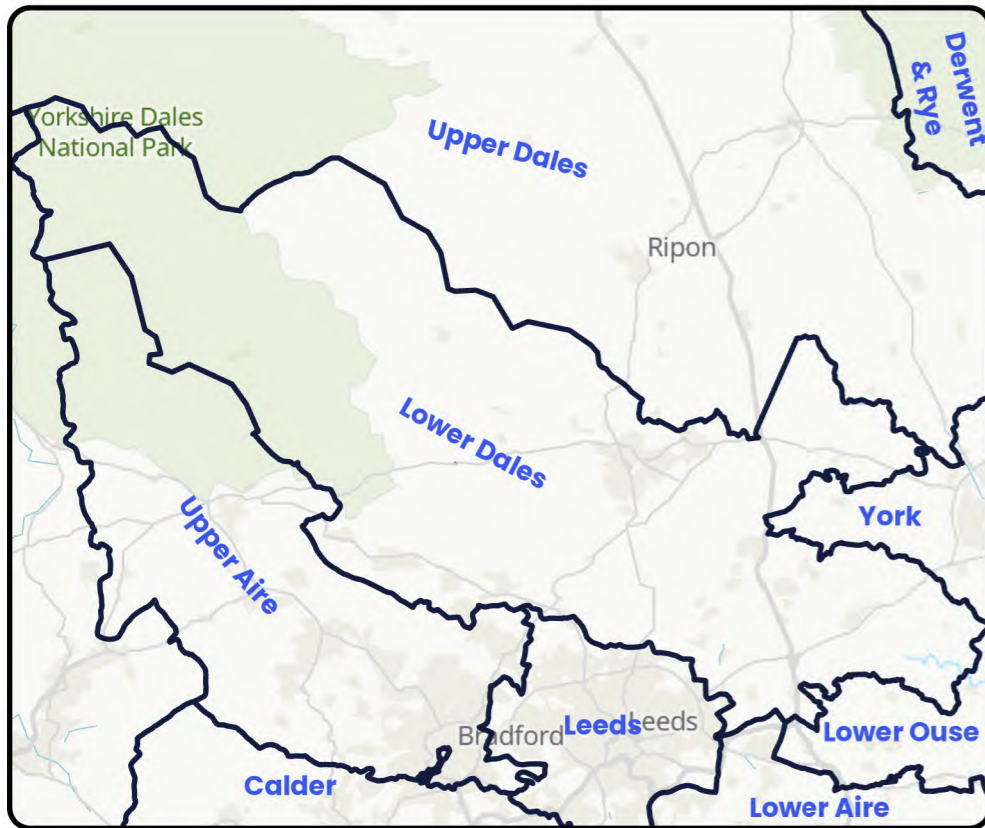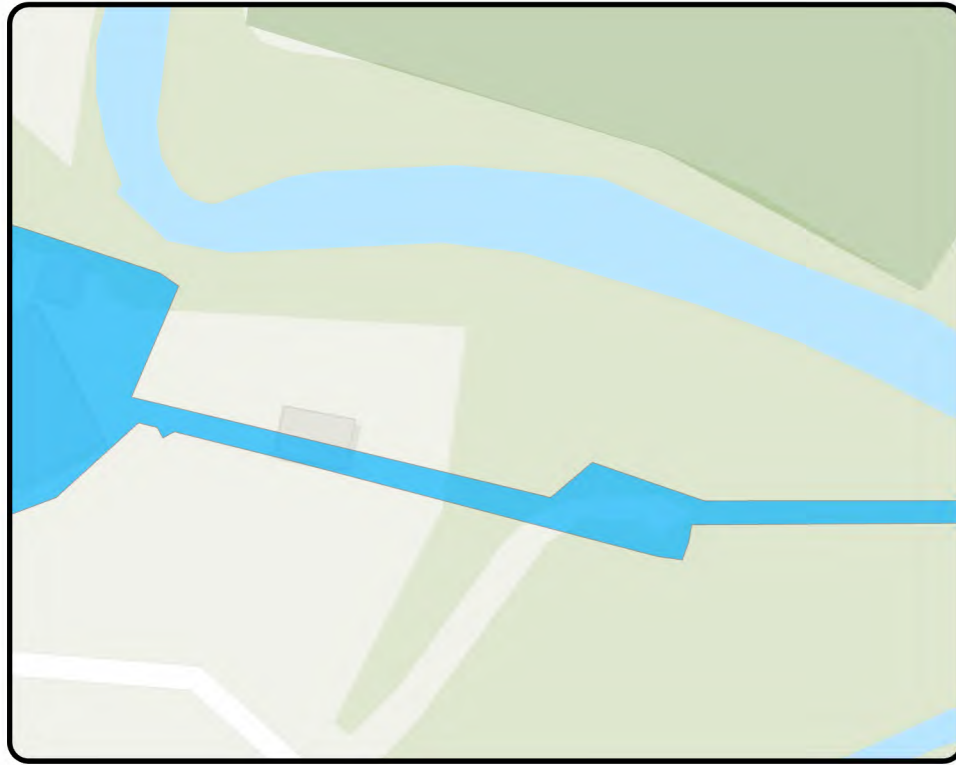

Outcome: Observe

Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	1
2050 Population Equivalent	1
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0.1km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low



Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A



Buckden Lower Dales

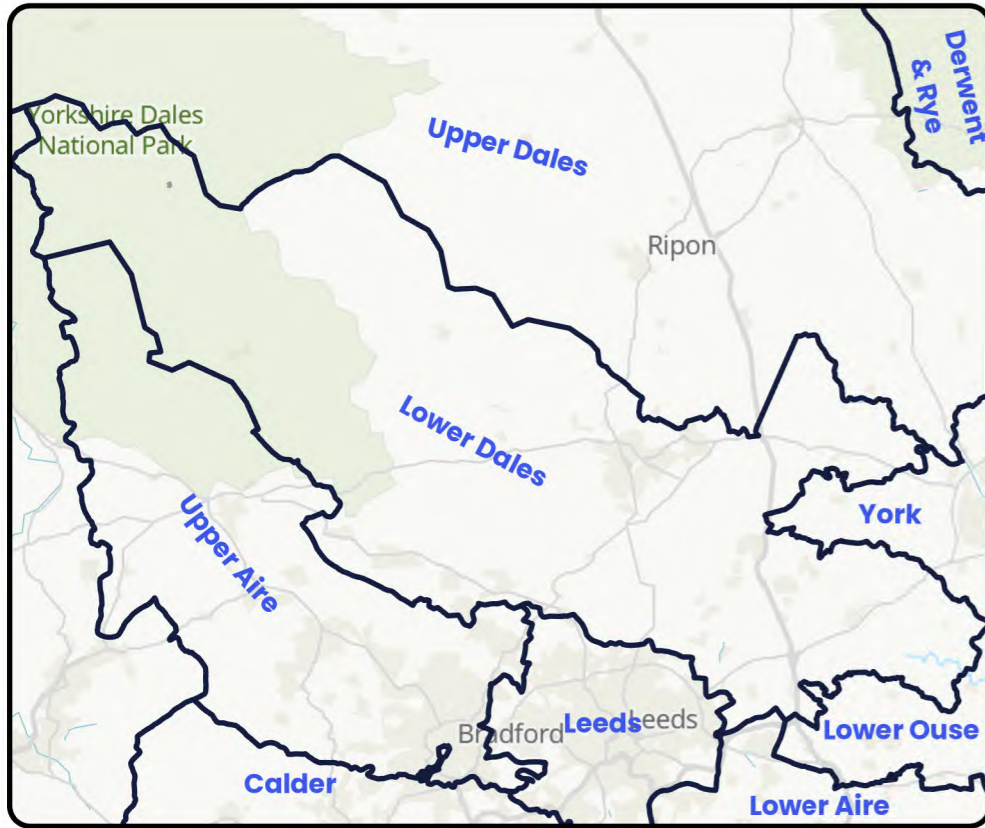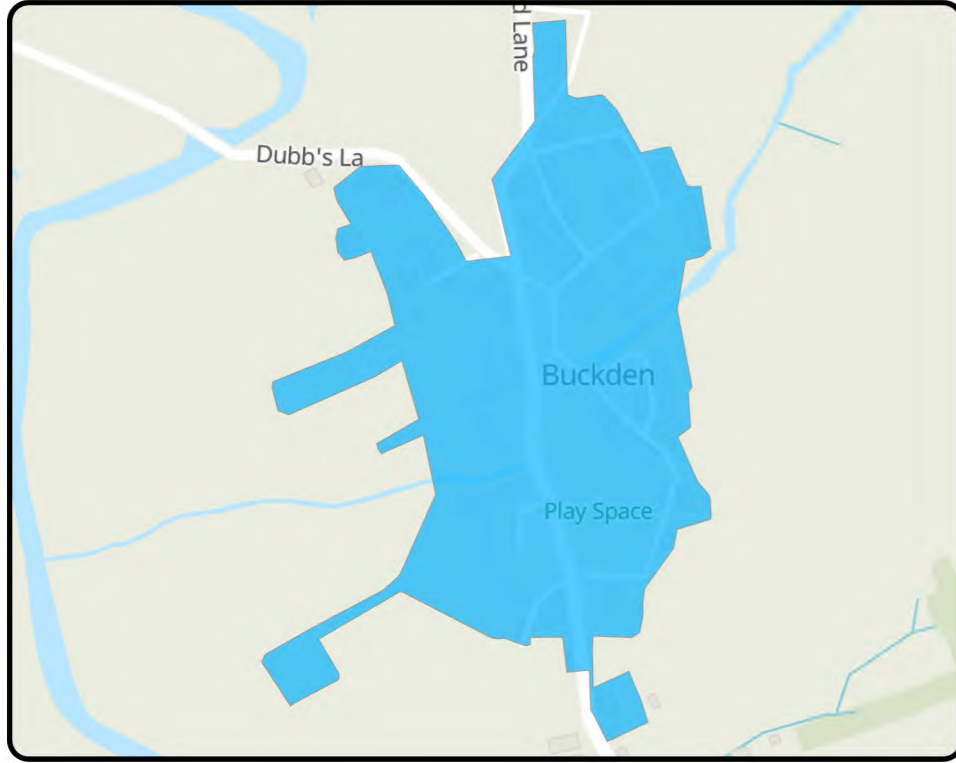

Outcome: Observe

Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	204
2050 Population Equivalent	221
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	1km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	Yes	NO


National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk

Burley in Wharfedale Lower Dales


Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working

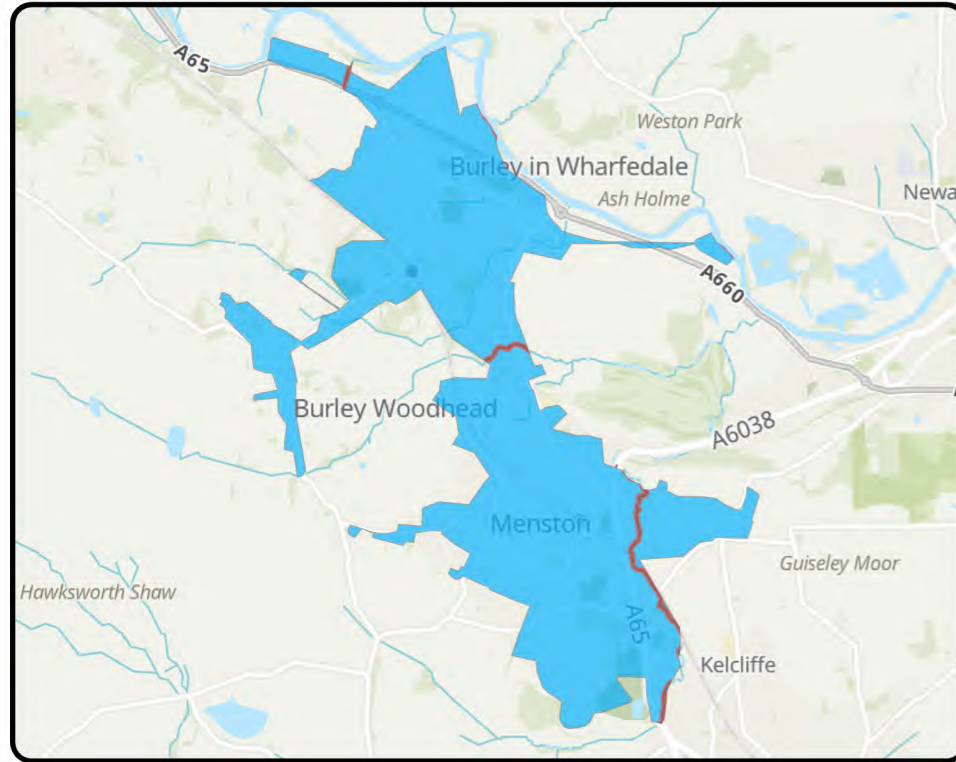

Key Catchment Statistics	
2020 Population Equivalent	13,413
2050 Population Equivalent	16,276
Modelled Consented Storm Overflows	7
Wastewater Pumping Stations	3
Foul and Combined Sewer Length	64km
Surface Water Sewer Length	20.7km
Site of Special Scientific Interest Present	Yes
Special Area of Conservation Present	Yes
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Medium

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents a moderate risk for 2050

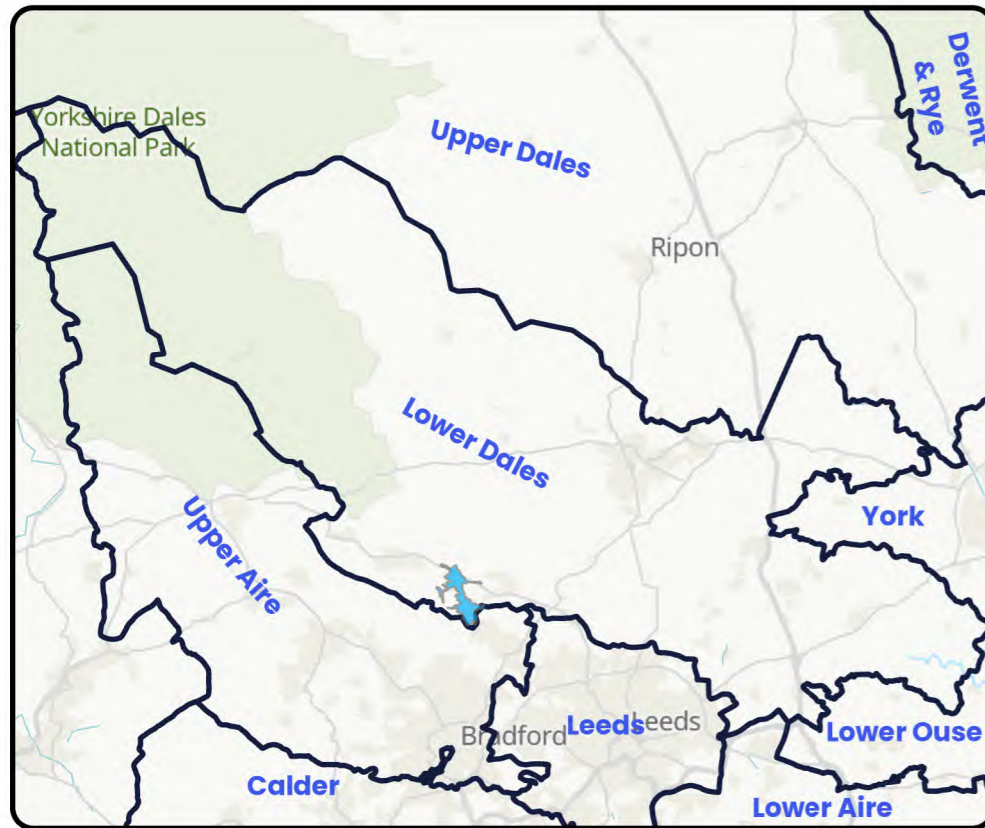


Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	Yes	Yes	Yes	No	No	No	No	Yes	No	Yes	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	2	0	2	2	2	2	0	0	5	5	5	5	5	5	2	2	3

0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk



Burnsall Lower Dales

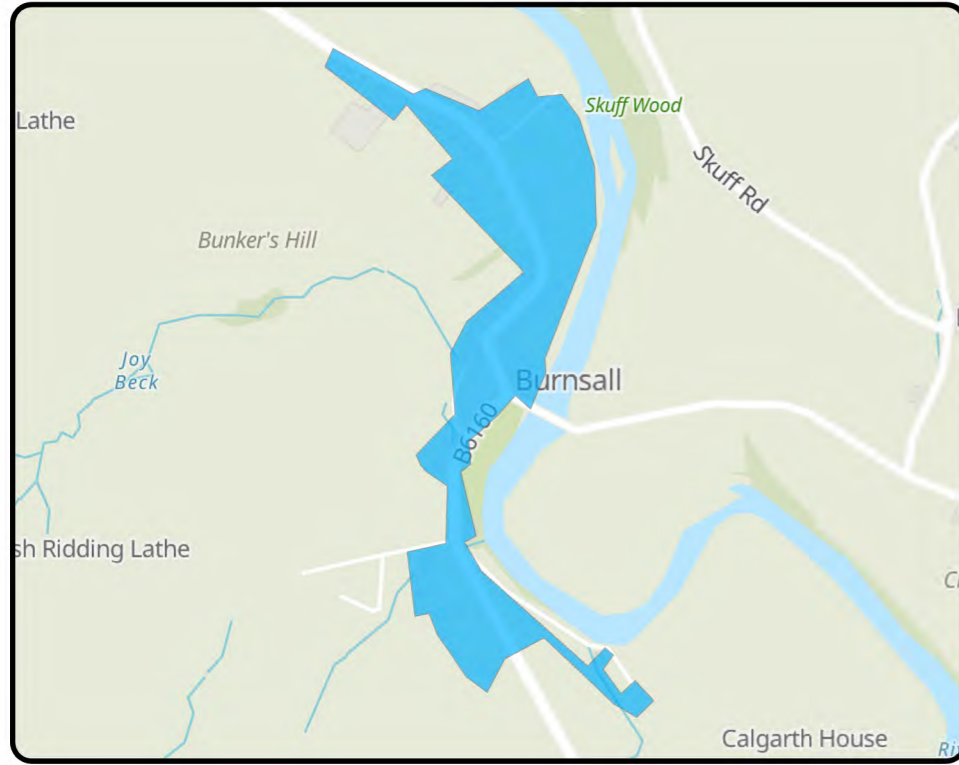


Outcome: Observe

Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles


Key Catchment Statistics	
2020 Population Equivalent	194
2050 Population Equivalent	192
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	1
Foul and Combined Sewer Length	1km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

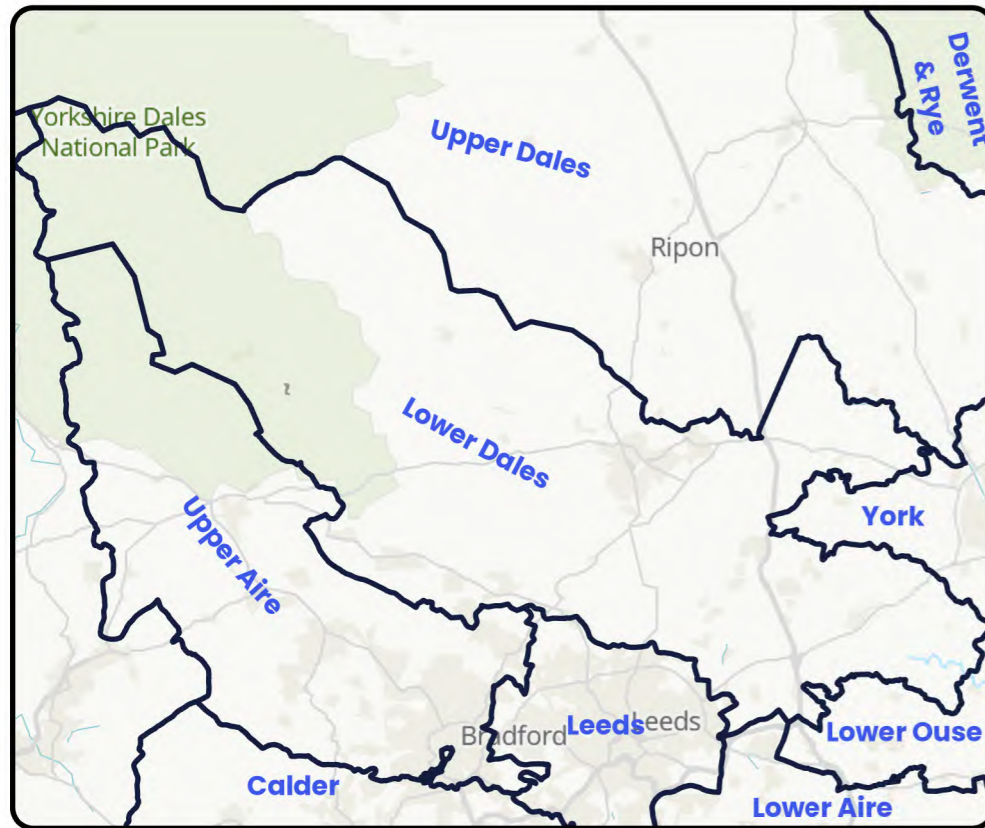


Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	Yes	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

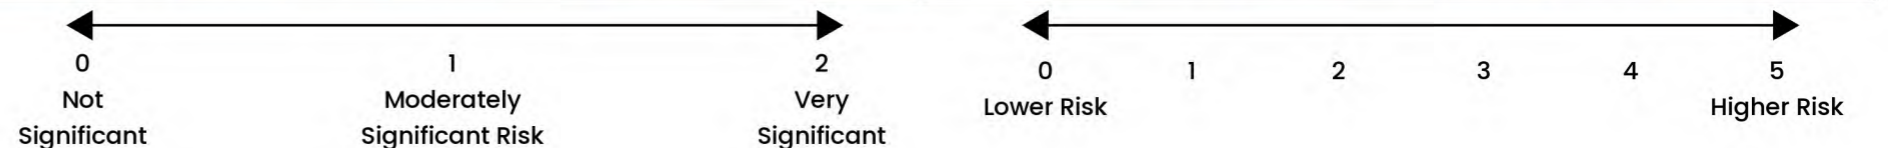

Conistone Lower Dales

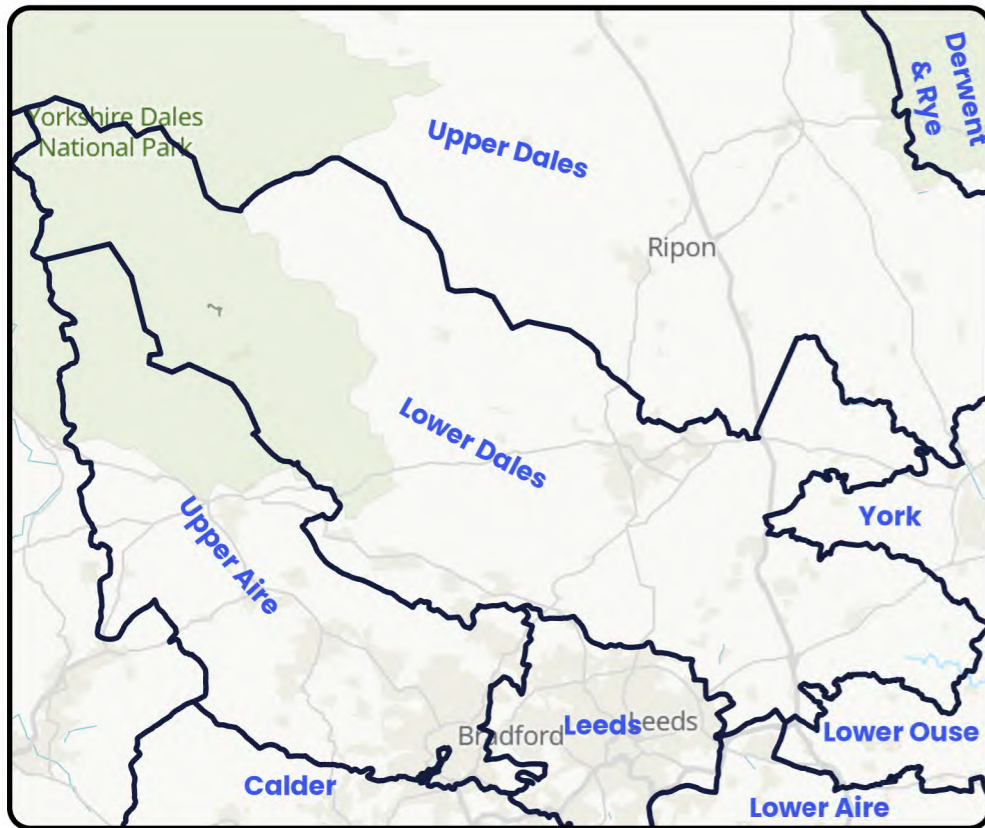

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	111
2050 Population Equivalent	112
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	2
Foul and Combined Sewer Length	0.8km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	Yes
Special Area of Conservation Present	Yes
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	Yes	No	NO


National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

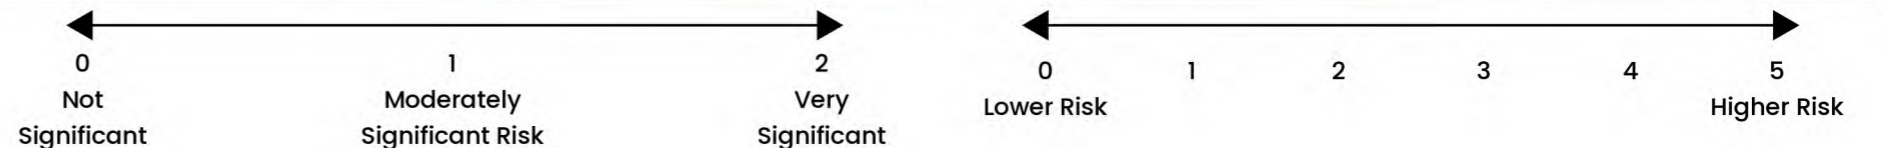

Crofton Calder


Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working

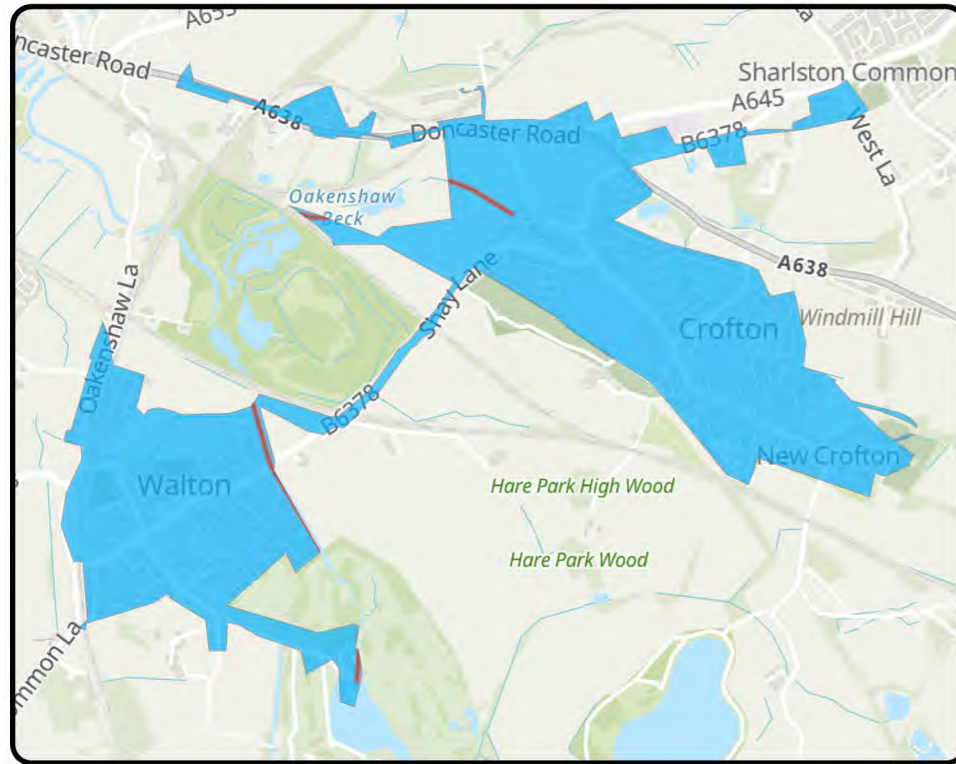


Key Catchment Statistics	
2020 Population Equivalent	9,478
2050 Population Equivalent	11,139
Modelled Consented Storm Overflows	2
Wastewater Pumping Stations	7
Foul and Combined Sewer Length	33.9km
Surface Water Sewer Length	17.2km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Medium

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a moderate risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

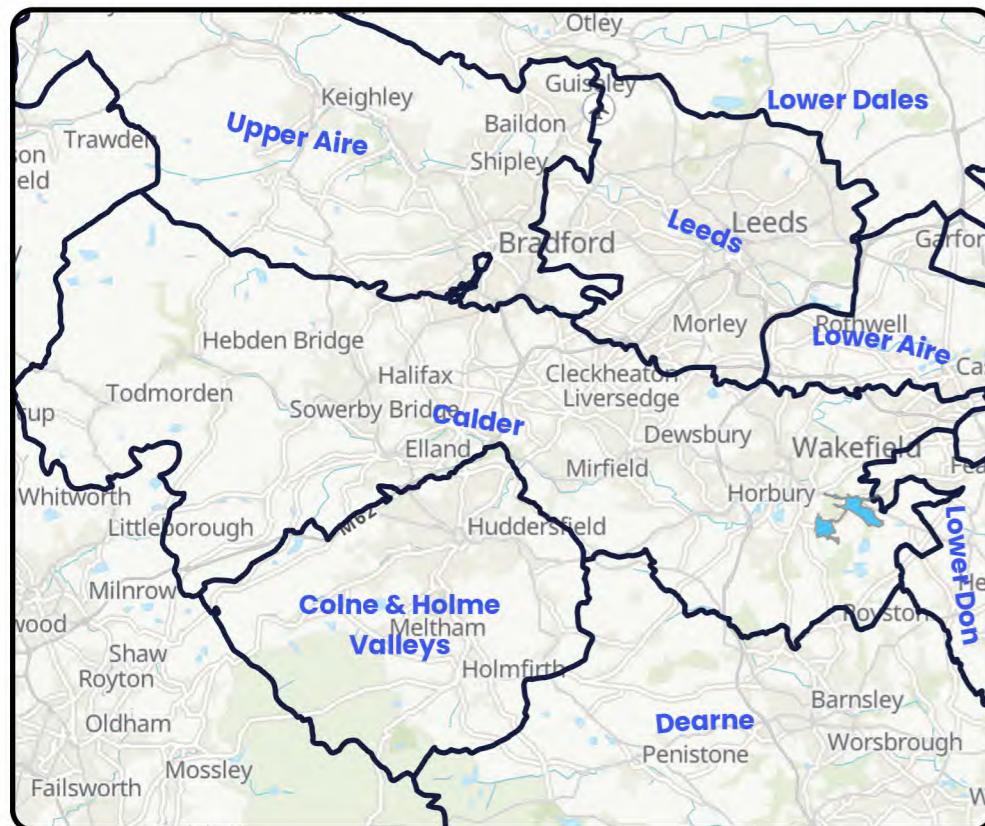

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	Yes	Yes	Yes	No	No	No	No	No	Yes	No	Yes	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	0	0	1	1	1	2	0	0	2	3	4	2	2	3	1	1	1

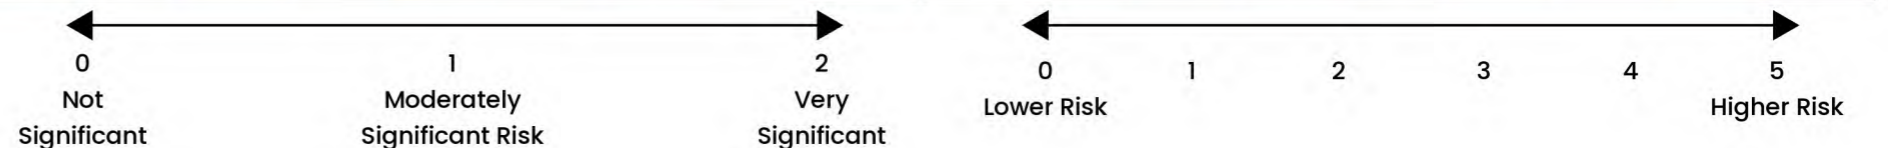

Darley Lower Dales


Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working




Key Catchment Statistics	
2020 Population Equivalent	2,113
2050 Population Equivalent	2,366
Modelled Consented Storm Overflows	3
Wastewater Pumping Stations	5
Foul and Combined Sewer Length	14.4km
Surface Water Sewer Length	0.4km
Site of Special Scientific Interest Present	Yes
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Medium

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents low risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents a high risk for 2050

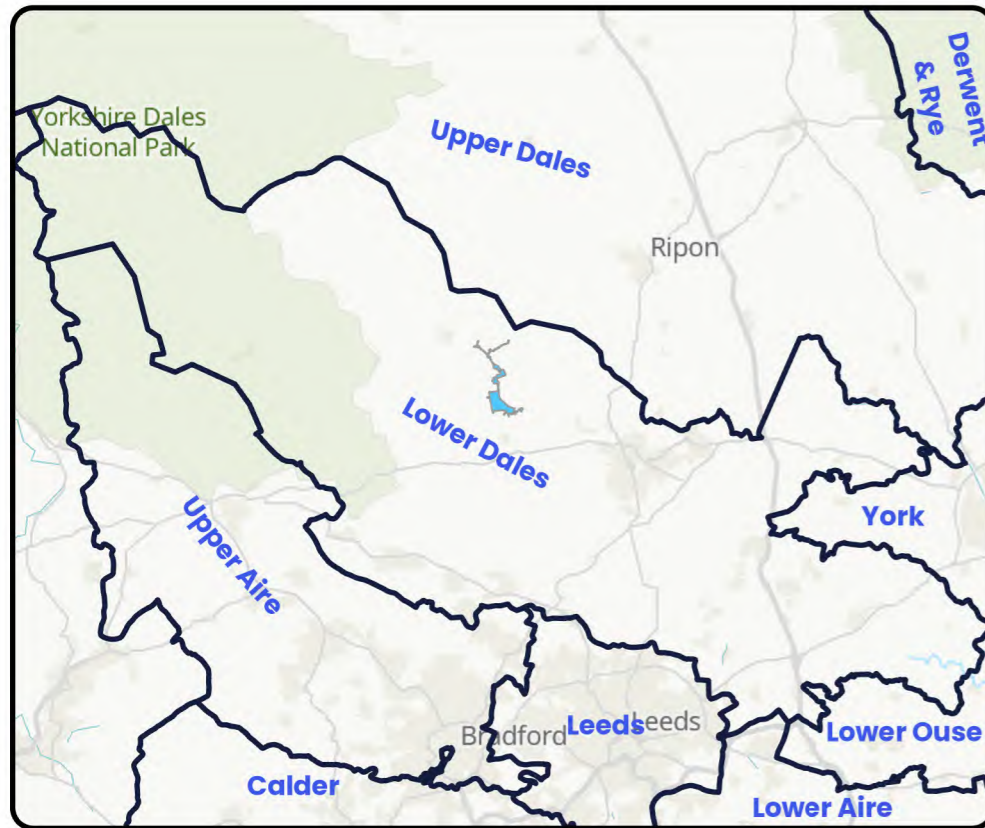


Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	Yes	No	Yes	Yes	No	No	Yes	No	No	No	Yes	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
0	0	0	1	1	2	2	1	2	1.5	1.5	1.5	4	5	5	4	4	4

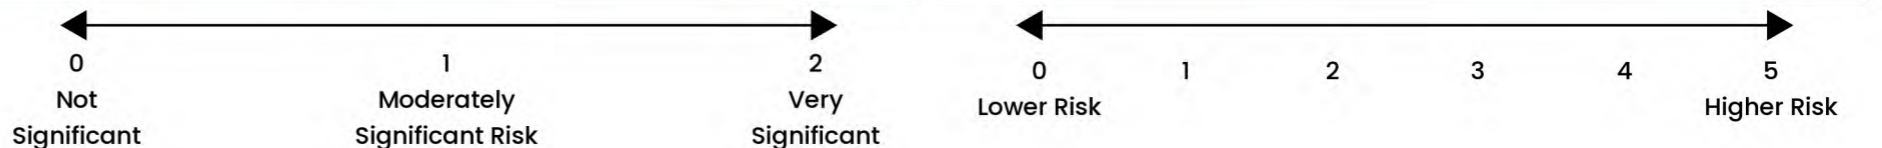

Dunkeswick Lower Dales

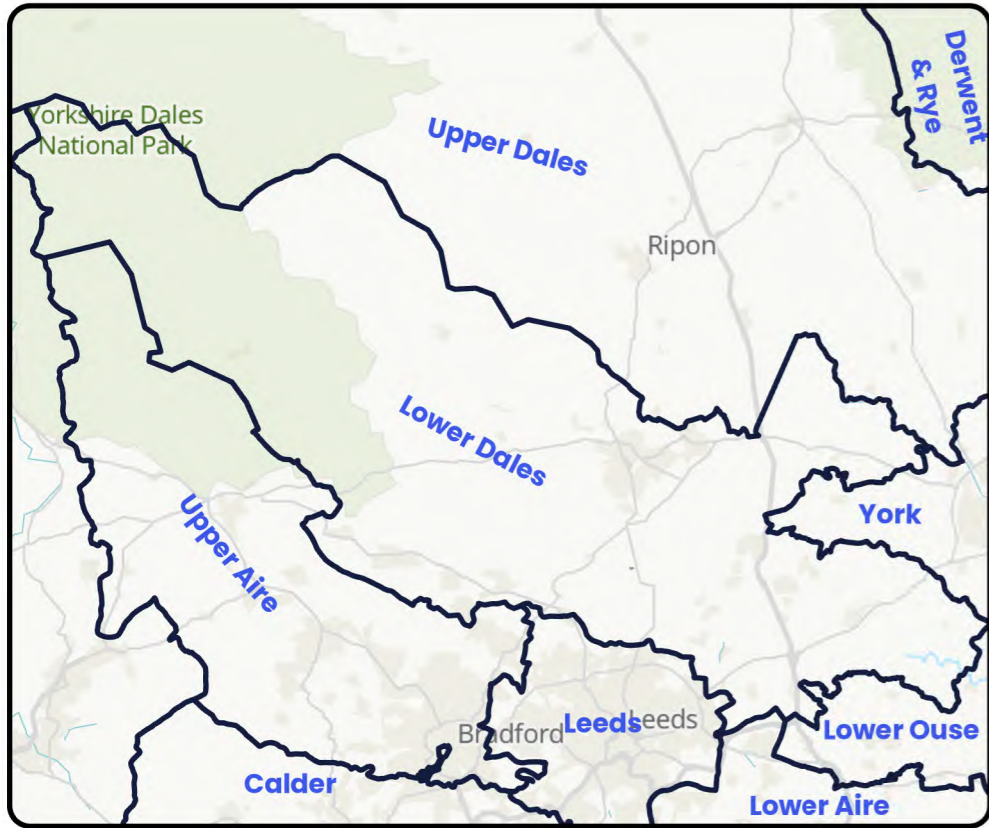

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	37
2050 Population Equivalent	41
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0.2km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low


Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

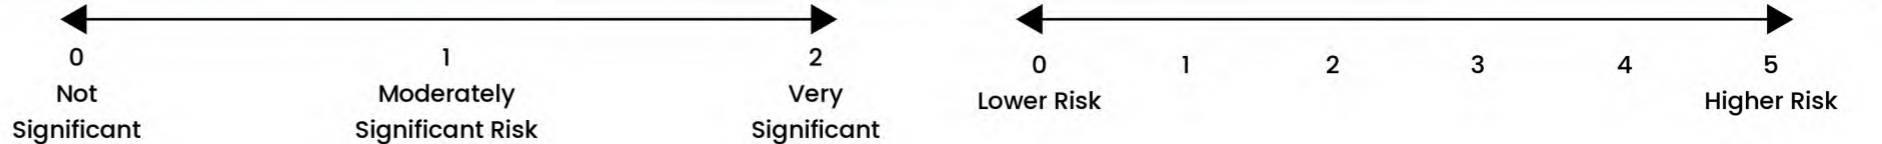

Eccup STW Lower Dales

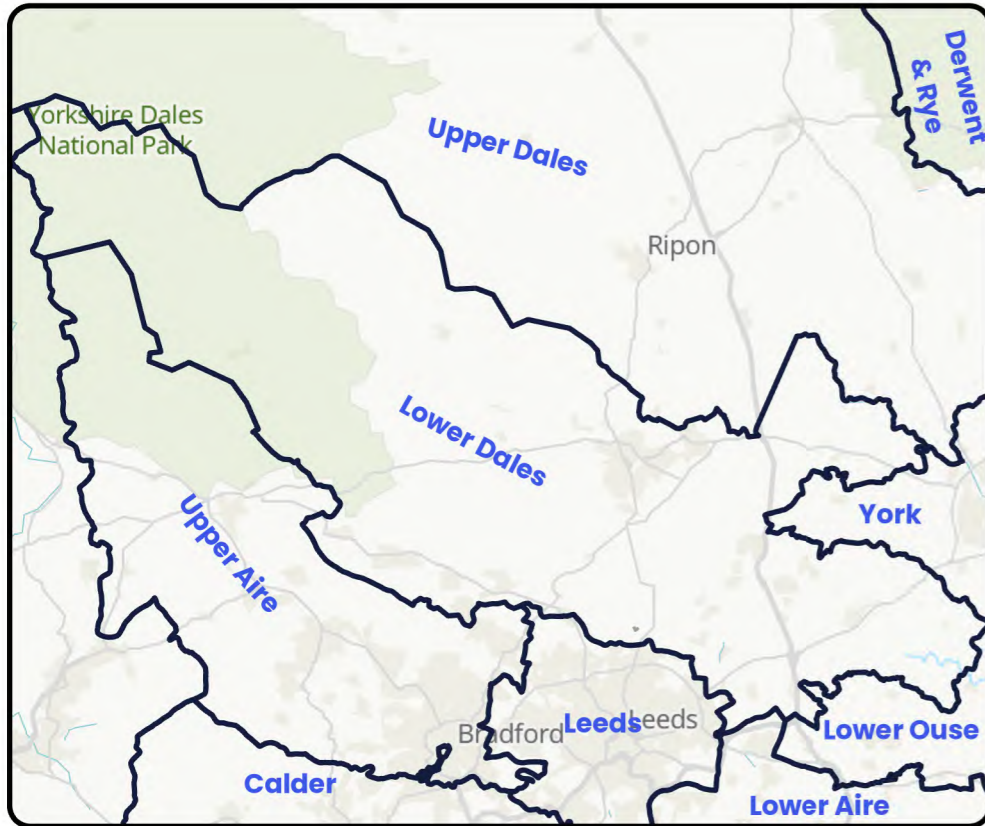

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	12
2050 Population Equivalent	14
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0.1km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low


Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

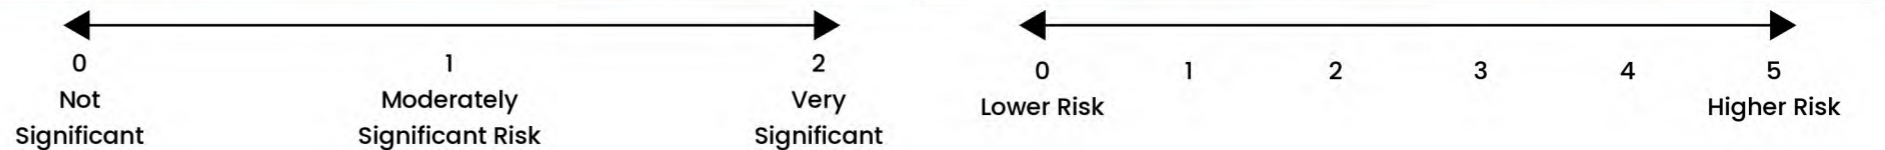

Eccup WTW Lower Dales

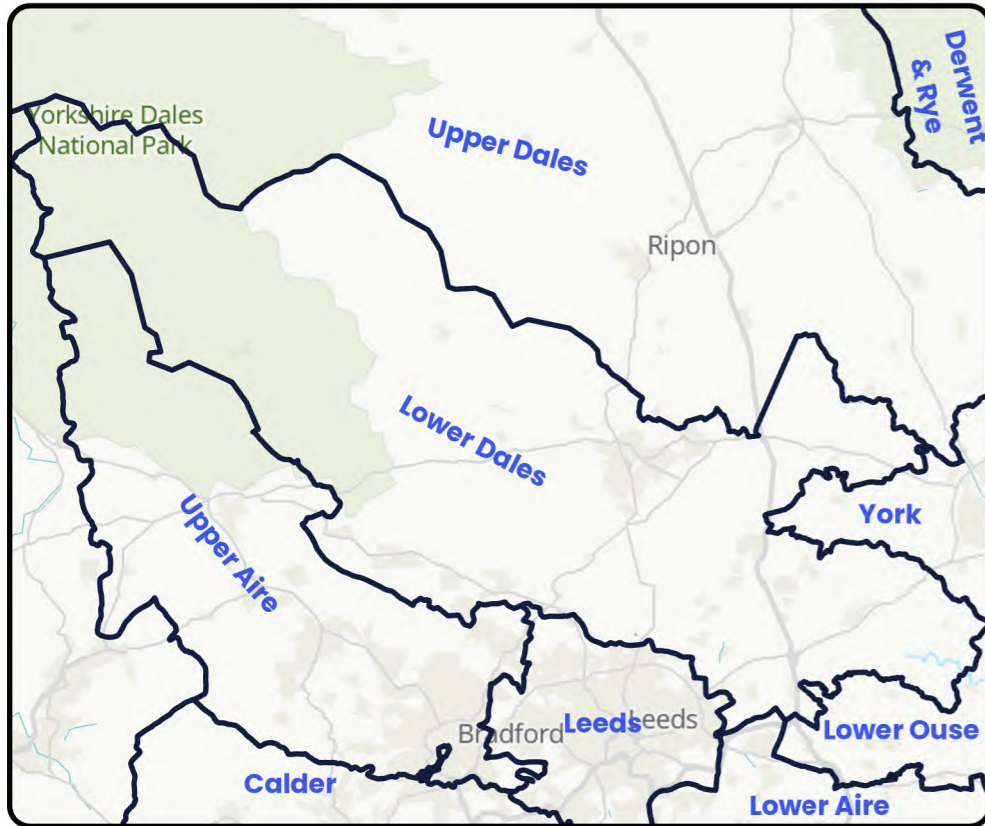

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	4
2050 Population Equivalent	5
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	Yes
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low


Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	No	NO

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

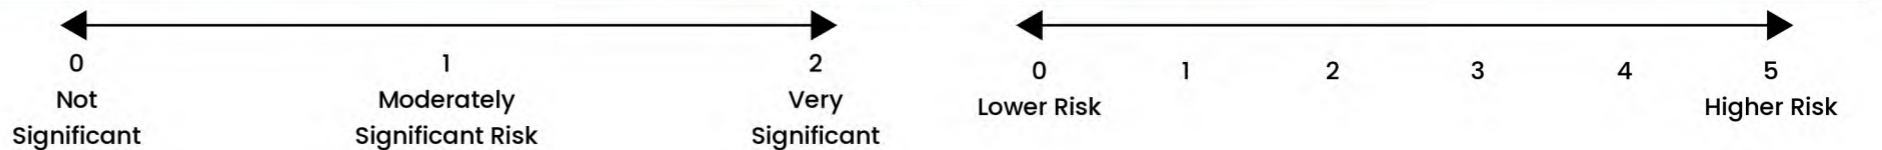

Grassington Lower Dales

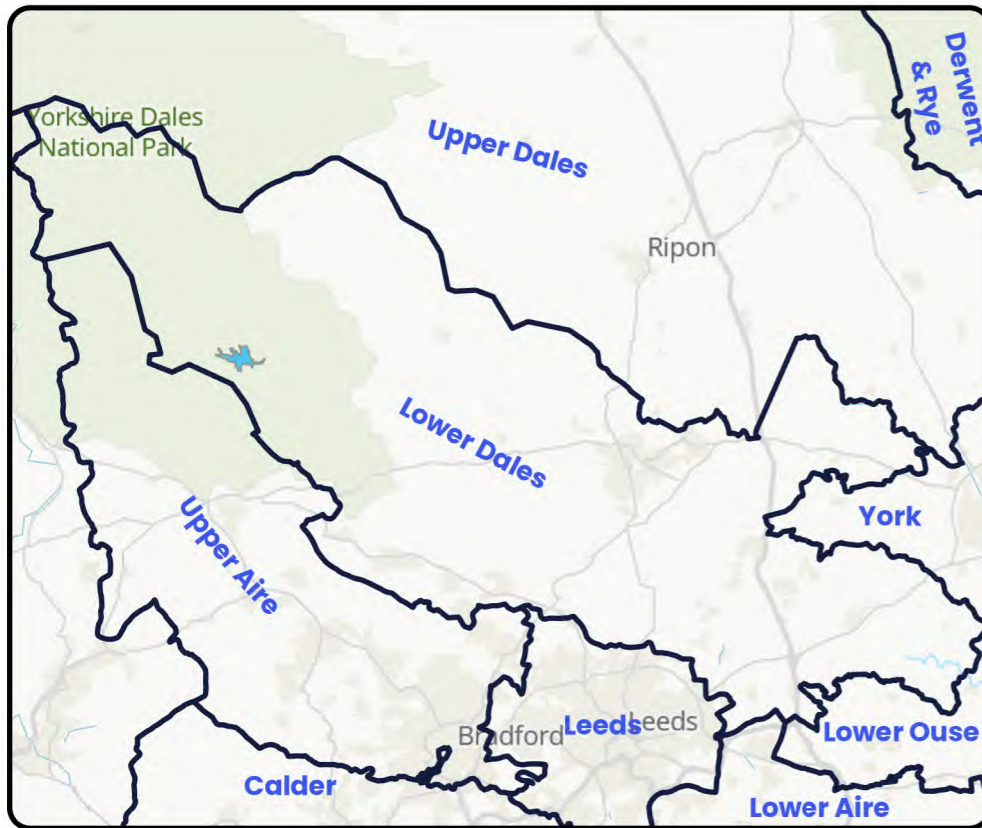

Outcome: Investigate


Work to understand in more detail the size and scale of the predicted catchment risk

Key Catchment Statistics	
2020 Population Equivalent	2,059
2050 Population Equivalent	2,334
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	2
Foul and Combined Sewer Length	11.4km
Surface Water Sewer Length	4.3km
Site of Special Scientific Interest Present	Yes
Special Area of Conservation Present	Yes
Priority River Habitat	Yes
Catchment Wider Resilience Risk Band	Low


Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	Yes	Yes	No	No	No	No	No	Yes	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	0	2	2	2	0	0	0	0	4	4	4	5	5	5	1	1	1

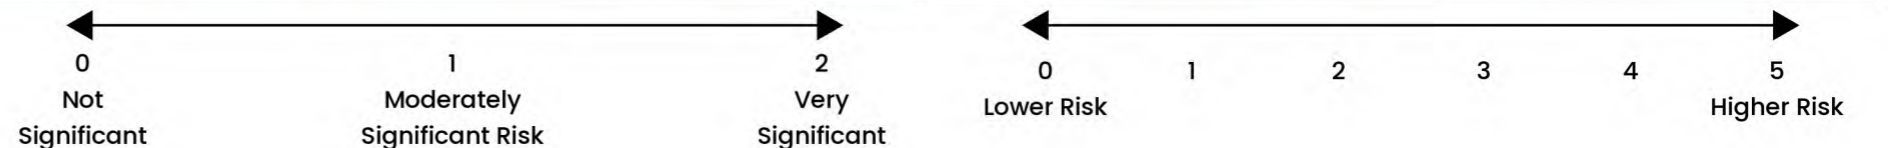

Grimwith Lower Dales

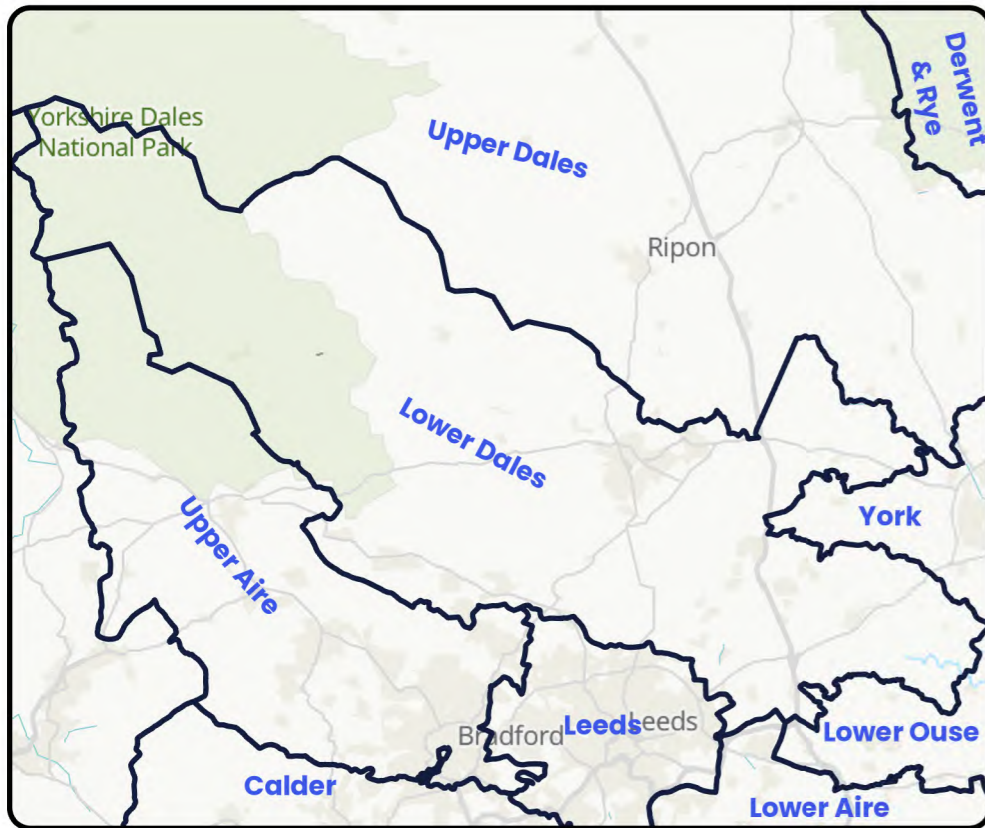

Outcome: Observe


Did not trigger the required number of indicators in the RBCS process so therefore was not assessed against any criteria but will be reviewed in future DWMP cycles

Key Catchment Statistics	
2020 Population Equivalent	6
2050 Population Equivalent	7
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	0km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
As this catchment did not progress through to the BRAVA stage, we have not determined a risk position for our sewer flooding planning objective
Storm Overflow Risk
As this catchment did not progress through to the BRAVA stage we have not determined a risk position for our Storm Overflow planning objective
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	No	No	Yes	No	NO


National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

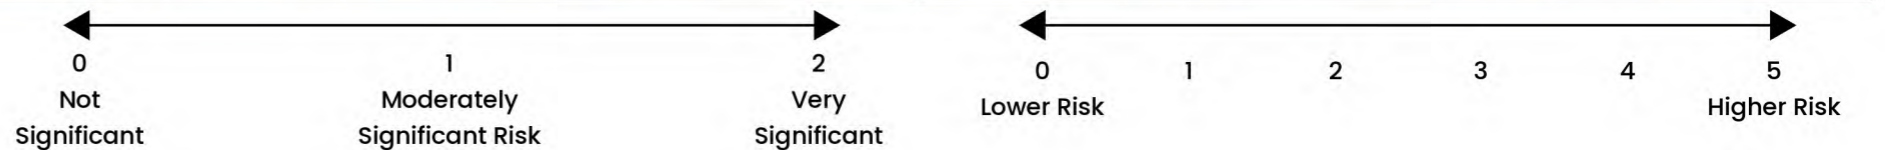

Harrogate North Lower Dales


Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working

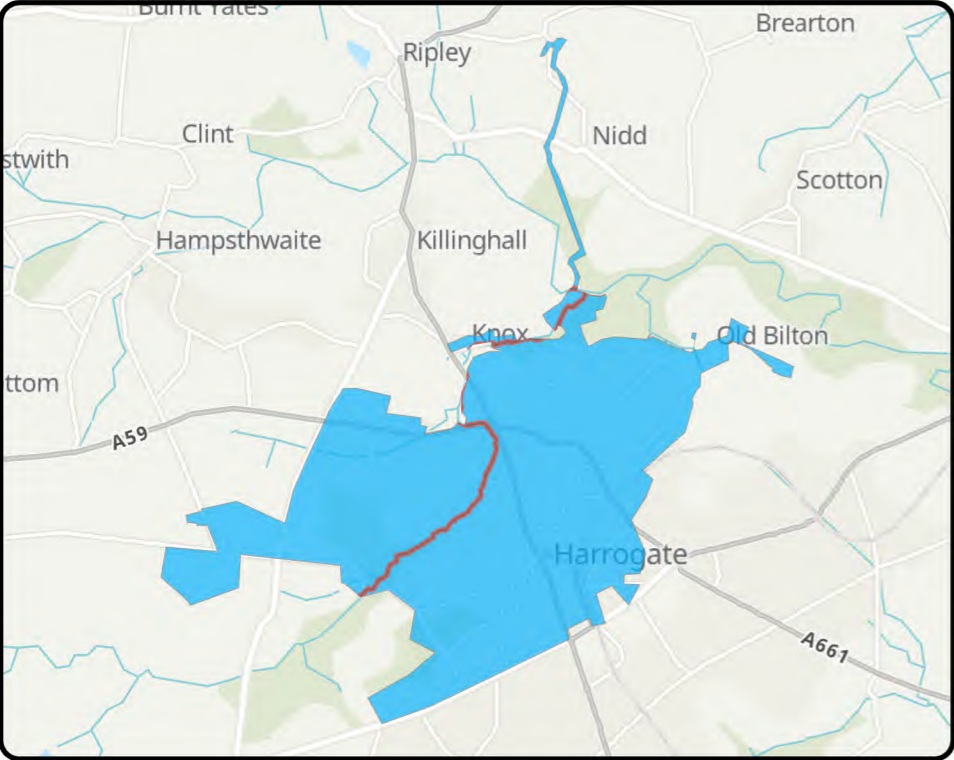

Key Catchment Statistics	
2020 Population Equivalent	43,329
2050 Population Equivalent	47,872
Modelled Consented Storm Overflows	26
Wastewater Pumping Stations	7
Foul and Combined Sewer Length	165.7km
Surface Water Sewer Length	122.7km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Medium

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents a high risk for 2050

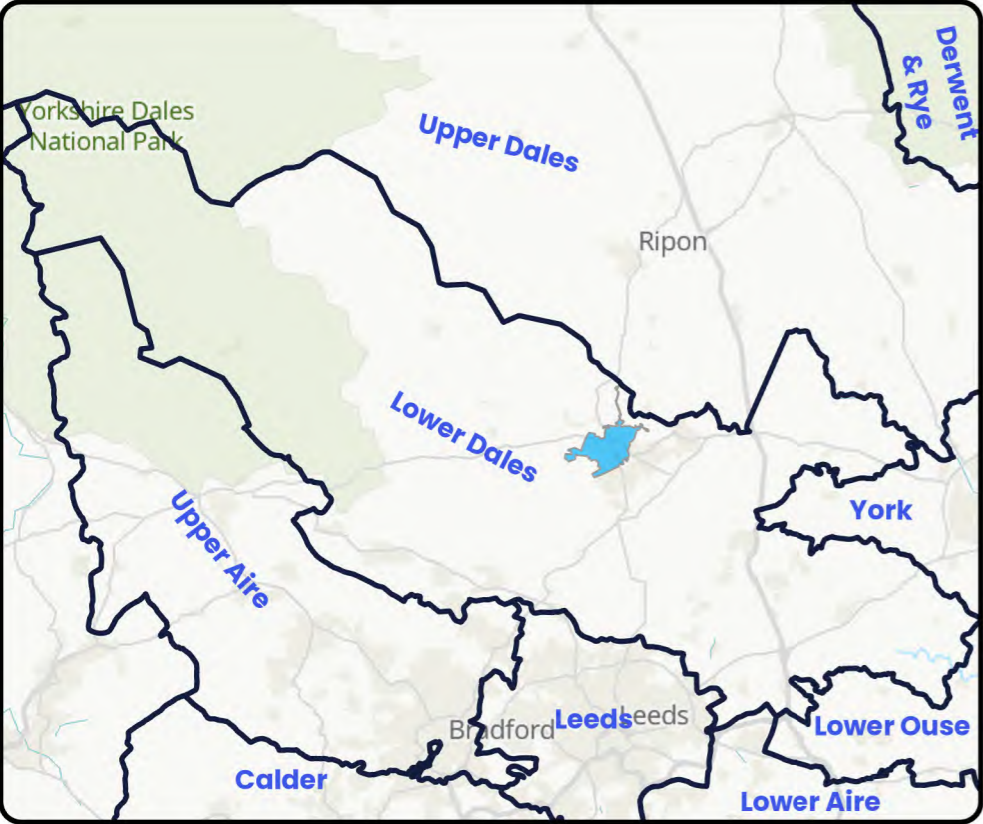

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	Yes	No	Yes	Yes	Yes	No	No	Yes	No	Yes	Yes	Yes	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	2	0	1	2	2	2	2	2	3.5	4	4.5	4	4	4	4	4	4



Harrogate South Lower Dales


Outcome: Promote

Develop strategic catchment based solution options to address predicted risks and look for potential opportunities for partnership working



Key Catchment Statistics	
2020 Population Equivalent	39,001
2050 Population Equivalent	43,530
Modelled Consented Storm Overflows	16
Wastewater Pumping Stations	14
Foul and Combined Sewer Length	165.6km
Surface Water Sewer Length	149.7km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	High

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a high risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

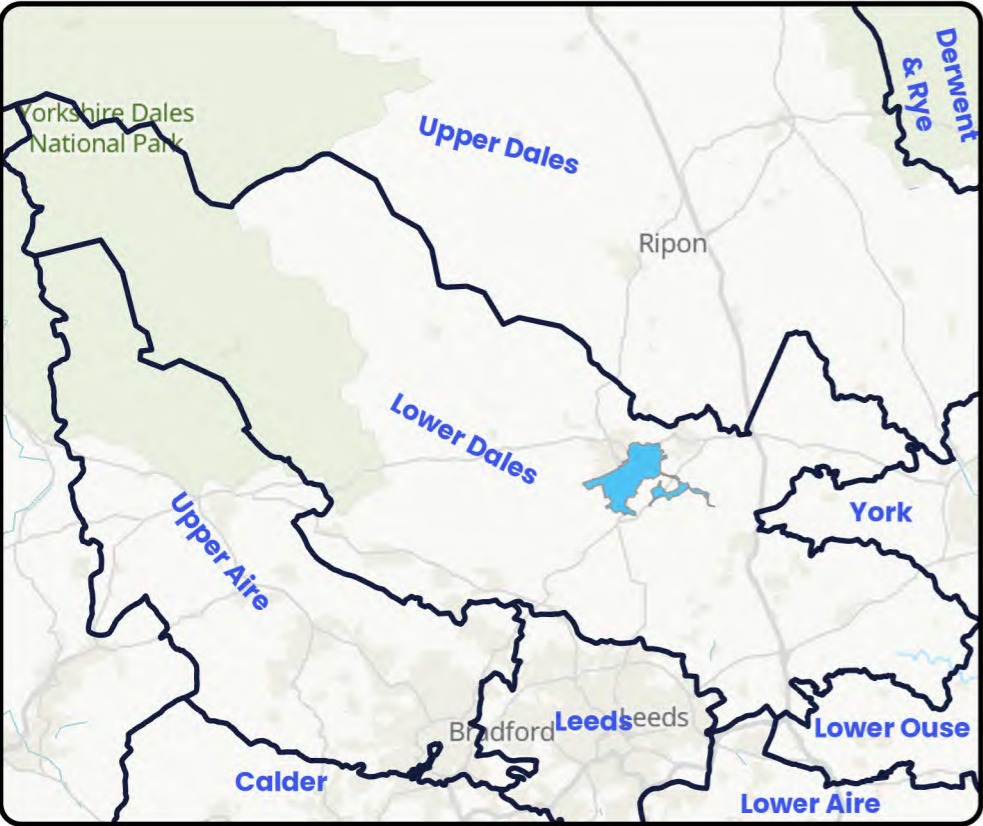

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	Yes	Yes	Yes	Yes	Yes	No	No	Yes	No	Yes	Yes	Yes	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
2	2	0	2	2	1	2	0	0	4	4.5	5	3	4	4	1	1	2



Healaugh (Tadcaster) Lower Dales


Outcome: Monitor

Continue to monitor all potential risks in the catchment and promote once a suitable threshold is breached



Key Catchment Statistics	
2020 Population Equivalent	112
2050 Population Equivalent	139
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	1
Foul and Combined Sewer Length	0.5km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents low risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents low risk for 2050
WwTW Compliance Risk
As this catchment did not progress through to the BRAVA stage or is a descriptive works, we have not determined a risk position for our WwTW Compliance risk planning objective

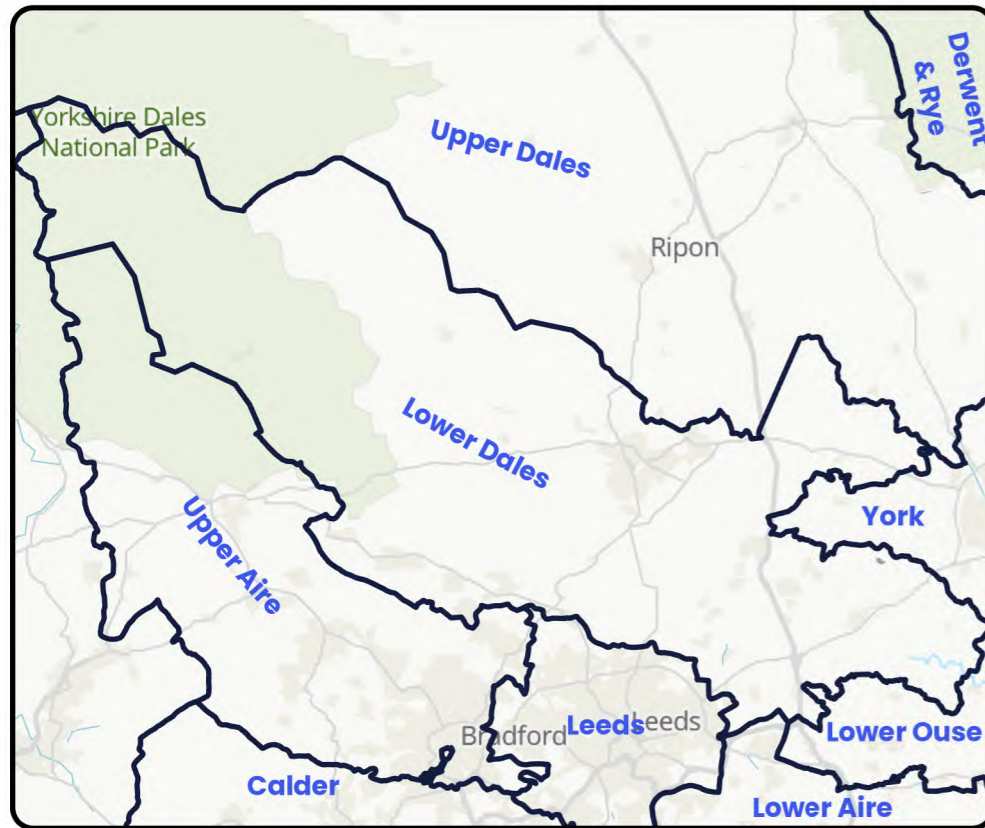


Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	No	No	No	No	No	Yes	No	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
0	0	0	0	0	N/A	N/A	N/A	N/A	1	1	1	0	0	0	N/A	N/A	N/A

0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk



Hebden Lower Dales

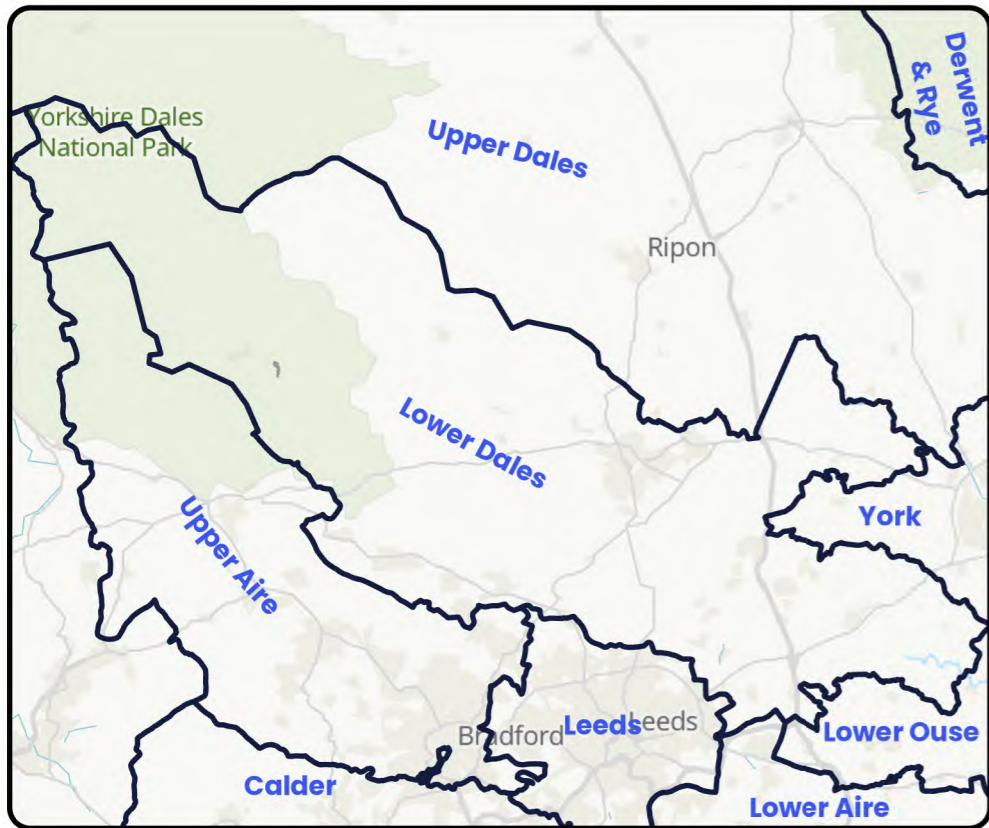

Outcome: Investigate


Work to understand in more detail the size and scale of the predicted catchment risk

Key Catchment Statistics	
2020 Population Equivalent	238
2050 Population Equivalent	257
Modelled Consented Storm Overflows	-
Wastewater Pumping Stations	0
Foul and Combined Sewer Length	1.4km
Surface Water Sewer Length	0km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a moderate risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	No	No	No	Yes	No	No	No	No	No	Yes	Yes	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
0	0	0	2	2	2	2	N/A	N/A	2.5	2.5	2.5	5	5	5	1	1	1

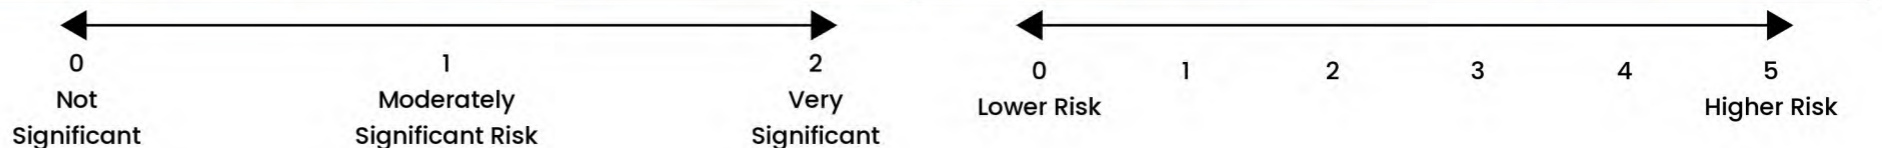

Hunsingore Lower Dales


Outcome: Investigate

Work to understand in more detail the size and scale of the predicted catchment risk



Key Catchment Statistics	
2020 Population Equivalent	233
2050 Population Equivalent	260
Modelled Consented Storm Overflows	1
Wastewater Pumping Stations	2
Foul and Combined Sewer Length	1.6km
Surface Water Sewer Length	0.1km
Site of Special Scientific Interest Present	No
Special Area of Conservation Present	No
Priority River Habitat	No
Catchment Wider Resilience Risk Band	Low

Outcome Summary
Sewer Flooding Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for sewer flooding, we believe this catchment represents a moderate risk for 2050
Storm Overflow Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for Storm Overflows, we believe this catchment represents a high risk for 2050
WwTW Compliance Risk
By assessing our hydraulic modelling outputs or where not available, our unmodelled methodology, against our bespoke planning objective for WwTW Compliance risk, we believe this catchment represents low risk for 2050

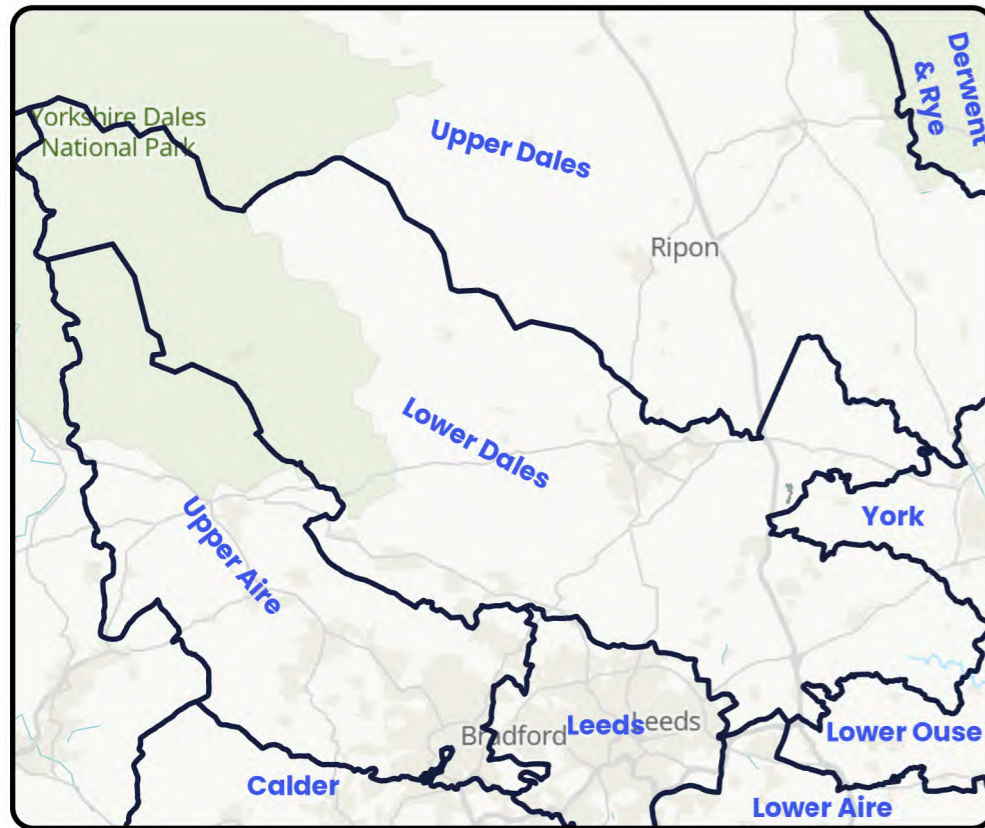

Risk Based Catchment Screening																	
Catchment Characterisation	Bathing or Shellfish Waters	Discharge to sensitive	Discharge to sensitive	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Proceed to BRAVA
Yes	No	No	No	No	Yes	No	No	Yes	No	No	No	No	No	No	No	Yes	YES

National Baseline Risk and Vulnerability Assessment									Bespoke Planning Objectives								
Internal Sewer Flooding 2020 Score	Pollution Risk 2020 Score	Sewer Collapse Risk 2020 Score	Risk of Sewer Flooding (1 in 50) 2020 Score	Risk of Sewer Flooding (1 in 50) 2050 Score	Storm Overflow Performance 2020 Score	Storm Overflow Performance 2050 Score	Risk of WwTW Compliance Failure 2020	Risk of WwTW Compliance Failure 2050	Annualised Flooding 2020 Score	Annualised Flooding 2030 Score	Annualised Flooding 2050 Score	Overflows Performance 2020 Score	Overflows Performance 2030 Score	Overflows Performance 2050 Score	WwTW Compliance 2020 Score	WwTW Compliance 2030 Score	WwTW Compliance 2050 Score
0	2	0	1	1	2	2	N/A	N/A	3	3	3	4	4	4	1	1	1

0 Not Significant 1 Moderately Significant Risk 2 Very Significant 0 Lower Risk 1 2 3 4 5 Higher Risk